



INSTALLATION MANUAL

Gas-fired Steam Humidifier
Condair GS
Series II

Humidification, Dehumidification
and Evaporative Cooling

condair



DANGER!
Fire or explosion hazard!

If the information in this manual is not followed exactly, a fire or explosion may result causing property damage, personal injury or loss of life.

DO NOT store or use gasoline or other flammable vapors and liquids in the vicinity of this or any other appliance.

WHAT TO DO IF YOU SMELL GAS

- DO NOT try to light any appliance.
- DO NOT touch any electrical switch.
- DO NOT use any phone in the building.
- Close the gas valve.
- Open windows and doors.
- Immediately call your gas supplier from a neighbor's phone. Follow the gas supplier's instructions.
- If you cannot reach your gas supplier, call the fire department.

Thank you for choosing Condair

Installation date (DD/MM/YYYY):

Commissioning date (DD/MM/YYYY):

Site:

Model:

Serial number:

Proprietary Notice

This document and the information disclosed herein are proprietary data of Condair Ltd. Neither this document, nor the information contained herein shall be reproduced, used, or disclosed to others without the written authorization of Condair Ltd., except to the extent required for installation, operation or maintenance of the customer's equipment.

Liability Notice

Condair Ltd. does not accept any liability due to incorrect installation, maintenance or operation of the equipment, or due to the use of parts/components/equipment that are not authorized by Condair Ltd.

Copyright Notice

© Condair Ltd., All rights reserved.

Technical modifications reserved

Contents

1	Introduction	6
1.1	Notes on this manual	6
2	For Your Safety	7
3	Receiving and Storage	10
3.1	Inspection	10
3.2	Storage and Transportation	10
4	Product Overview	11
4.1	General Description	11
4.2	Model Designation	11
4.3	Model Specifications	12
4.4	Options	14
4.5	Accessories	14
5	Mounting and Installation Work	15
5.1	General	15
5.2	Installation Overview	16
5.2.1	Typical Installation – Compact Units	16
5.2.2	Typical Installation – Full-Size Units	17
5.3	Site Requirements	18
5.4	Mounting the Humidifier	20
5.4.1	Clearances	20
5.4.1.1	Overall Dimensions and Weight	22
5.4.2	Removing the Shipping Pallet	23
5.4.3	Wall Mounting – Compact Unit Only	23
5.4.4	Floor Stand Mounting - Compact Unit	24
5.4.5	Floor Stand Mounting - Full Size unit	25
5.4.6	Mounting Checklist	25
5.5	Steam Connection	26
5.5.1	Installing the Main Steam Pipe	26
5.5.2	Best Practices for Installing Steam and Condensate Lines	27
5.5.2.1	Common Steam and Condensate Line Installation Mistakes	30
5.5.3	Steam Connection Checklist	31
5.6	Water Installation	32
5.6.1	Water Connections	32
5.6.2	Installing Exhaust Condensate Drain Line (CS/NX Model Only)	33
5.6.3	Notes on Water Connections	34
5.6.4	Water Connections Checklist	36
5.7	Combustion Air Connection	37
5.7.1	Space Air Installation	37
5.7.2	Sealed Combustion Installation	38
5.7.3	Combustion Air Checklist	39

5.8	Exhaust Vent Installation	40
5.8.1	General Requirements	40
5.8.2	Exhaust Vent Installation for CS/NX/MT Model	45
5.8.2.1	Installation as a Category IV Appliance	45
5.8.2.2	Installation Requirements for Category IV Appliances	45
5.8.3	Exhaust Vent Checklist	46
5.9	Gas Connection	47
5.9.1	Gas Connection, Compact and Full-Size Unit	47
5.9.2	Gas Leakage Test	48
5.9.3	Gas Connection Checklist	48
5.10	Humidity Control Systems	49
5.10.1	Control Device Locations	49
5.10.2	Permissible Control Signal Inputs	49
5.11	Electrical Connections	50
5.11.1	General	50
5.11.2	Wiring Diagrams	51
5.11.2.1	Condair GS - All Units	51
5.11.2.2	Condair GS - 450/600	52
5.11.3	External Connections	53
5.11.3.1	External Security Loop	53
5.11.3.2	Modulating Demand or Humidity/Limiter Signal	54
5.11.3.3	On/Off Humidistat Signal	55
5.11.3.4	Full Tank Blowdown Signal Connection	55
5.11.3.5	Remote Fault PCB Connections	56
5.11.3.6	Single-Phase Power Supply Connection	57
5.11.3.7	Modbus Connection	58
5.11.4	Connecting Multiple Units Using Linkup	59
5.11.5	Electrical Connections Checklist	60
6	Commissioning	61
6.1	Commissioning Checklist	61
6.1.1	Pre-Start-Up Checklist	61
6.1.2	Performance Checklist	67
7	Installation Checklist	69
8	Product Specifications	72
8.1	Weights	72
8.2	Dimensions	72
9	Performance and Operating Data	77
9.1	Performance Data	77
9.2	Operating Data for GS Series II Indoor Models	77

1 Introduction

Thank you for purchasing the Condair GS steam humidifier.

The Condair GS steam humidifier incorporates the latest technical advances and meets all recognized safety standards. Improper use of the Condair GS humidifier may result in danger to the user or third parties, and/or damage to property.

To ensure a safe, proper, and economical operation of the Condair GS steam humidifier, observe and comply with all information and safety instructions contained in this manual, as well as all relevant documentation of components of the installed humidification system. Comply with all local and regional regulations dealing with gas, combustion air, flue gases, water, steam and electrical installations.

If you have additional questions, contact your Condair representative. They will be glad to assist you.

1.1 Notes on this manual

Limitation

The subject of this manual is the Condair GS steam humidifier in its different versions. The various options and accessories may only be described in-so-far as is necessary for proper installation and operation of the equipment. Additional information on available options and accessories can be obtained in the instructions that are supplied with them.

This manual is restricted to the installation of the Condair GS steam humidifier, and is intended for well trained personnel who are suitably qualified for their respective tasks.

Other Related Publications

This manual is supplemented by other publications such as the Operation and Maintenance Manual, Spare Parts List, etc., which are included in the delivery of the equipment. Where necessary, appropriate cross-references to these publications have been added in this manual.

Storage of Manual

Keep this manual in a place where it is safe and readily accessible. If the equipment is moved to another location, make sure that the manual is passed on to the new user. If the manual is lost or misplaced, contact your Condair representative for a replacement copy.

Language Versions

This manual is also available in other languages – contact your Condair representative.

2 For Your Safety

General

Every person who is tasked with the installation of the Condair GS humidifier must read and understand this manual before performing any work on the unit. Knowing and understanding the contents of the Installation Manual, and the Operation and Maintenance Manual is a basic requirement for protecting personnel against any kind of danger, preventing faulty operation, and operating the unit safely and correctly.

All labels, signs and markings applied to the Condair GS humidifier must be observed and kept in a readable state.

Personnel Qualifications

All procedures described in this manual must only be performed by personnel who are adequately qualified, well trained and are authorized by the customer.

For safety and warranty reasons, any activity beyond the scope of this manual must only be performed by qualified personnel authorized by Condair.

All personnel working with the Condair GS humidifier must be familiar with, and comply with the appropriate regulations on workplace safety and prevention of accidents.

Intended Use

The humidifier is intended exclusively for air humidification using a Condair-approved steam distributor within specified operating conditions (refer to the Operation and Maintenance Manual). Any other type of application, without the express written consent of Condair, is considered to be NOT conforming to its intended purpose, and may lead to dangerous operation and will void the warranty.

In order to operate the equipment in the intended manner all information contained in this manual, in particular the safety instructions, must be observed closely.

Safety Precautions that Must be Observed



DANGER!

Risk of electric shock!

The Condair GS humidifier is mains powered. Live parts may be exposed when the access panels are removed. Touching live parts may cause severe injury or even death.

Prevention: The Condair GS humidifier must be connected to the mains only after all installation work has been completed, checked for correct workmanship, and the access panels are installed properly and fastened securely.



WARNING!

Wiring errors can cause improper and dangerous operation of the humidifier!

Prevention: Tag all wires before disconnecting them. Reconnect all wires correctly after servicing, and check the unit functions properly.



CAUTION!

Electrostatic discharge (ESD)!

The electronic components inside the control cabinet in the humidifier are sensitive to electrostatic discharge (ESD).

Prevention: Take appropriate measures to protect the electronic components inside the unit against damage caused by electrostatic discharge (ESD).



DANGER!
Risk of fire or explosion!

The Condair GS is a gas-fired humidifier. Improper installation, adjustment, alteration, service, maintenance or use can cause carbon monoxide poisoning, explosion, fire or other hazards that can cause serious injury, death or property damage.

If over-heating occurs or if the gas fails to shut off: Shut off the gas supply at the manual gas shutoff valve before shutting off the electrical power supply.

DO NOT use this appliance if any part has been under water. Call a qualified service technician immediately to inspect and replace any part of the control system or gas control that has been under water.

Any work on the gas system must only be performed by a qualified installer, service agency or your local gas supplier. Use only factory-authorized and listed kits or accessories when installing or modifying this appliance.

DO NOT store or use gasoline or other flammable vapours and liquids in the vicinity of the humidifier or any other appliance.

What to do if You Smell Gas:

DO NOT try to light any appliance.

DO NOT touch any electrical switch.

DO NOT use any phone in the building.

Leave the building immediately.

Call your gas supplier immediately from a location far away from the building with the gas leak.

Follow the gas supplier's instructions.

If you cannot reach your gas supplier, call the fire department.



WARNING!
Risk of severe burns from contact with hot steam vapours!

The Condair GS humidifier produces hot steam vapours for humidification. Bare skin in contact with hot steam vapours can result in severe burns.

Prevention: Avoid contact with steam vapours, or wear appropriate personal protective equipment when working near steam vapours.



WARNING!
Risk of severe burns from contact with hot surfaces!

The water tank, steam line and exhaust system in the Condair GS humidifier get very hot during operation. Bare skin in contact with hot surfaces can result in severe burns.

Prevention: Shut down the Condair GS steam humidifier and wait for the components to cool down before performing any work on the unit, or wear appropriate personal protective equipment. Never use the manual drain valve until the unit has cooled down.

Preventing Unsafe Operation

All personnel working with the unit must immediately report to the customer any alterations to the unit that may affect safety, and secure it against accidental power-up.

DO NOT modify this appliance

Modifications are **NOT permitted** on the Condair GS humidifier without the express written consent of Condair.

Always use original Condair replacement parts and accessories available through your Condair representative.

The location of the various safety labels on the Condair GS humidifier is shown below.

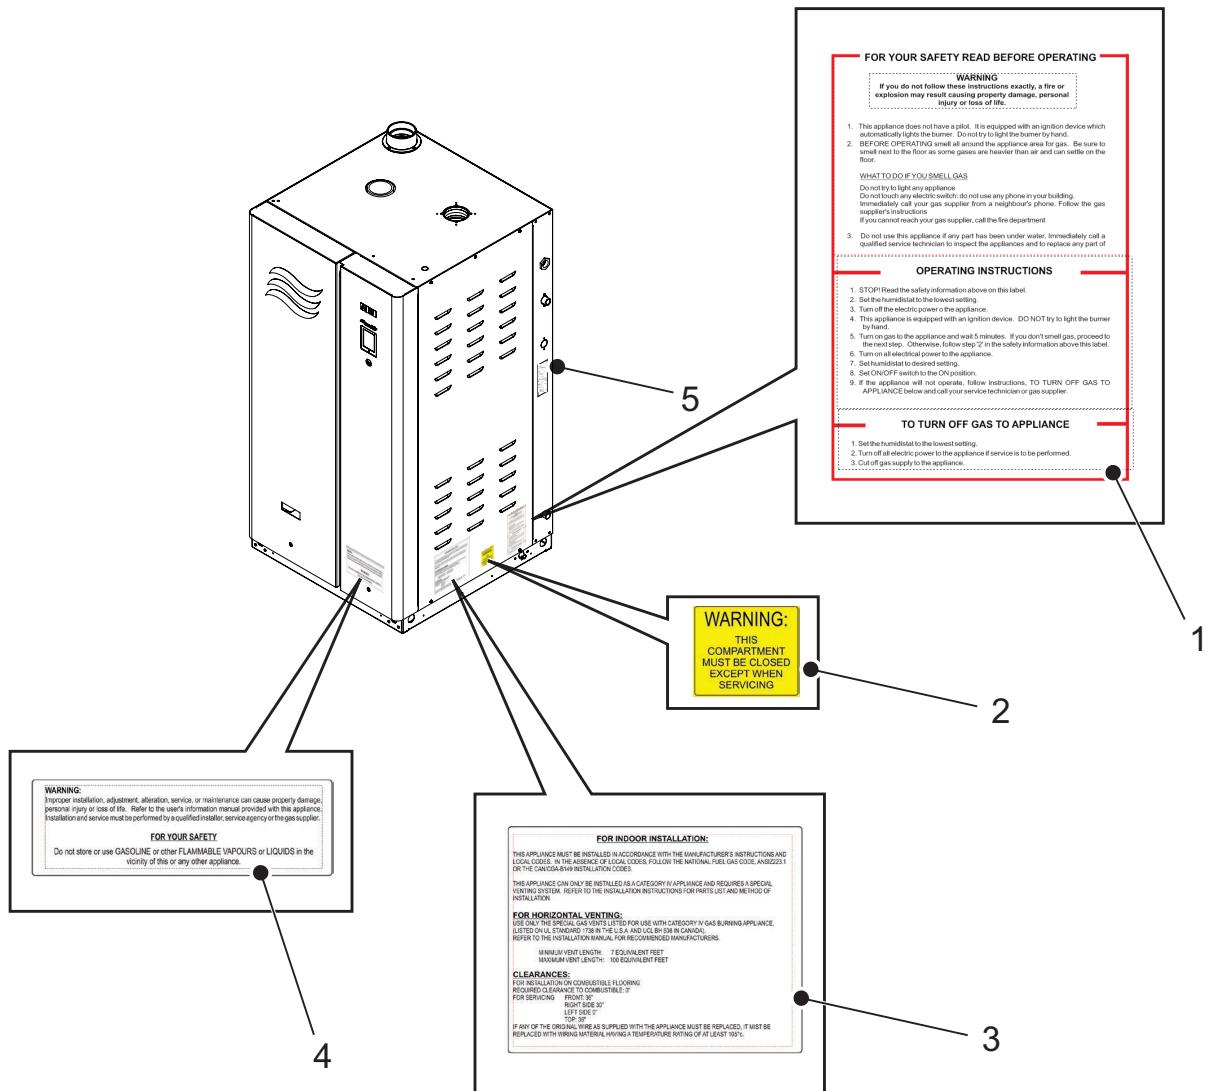


Figure 1: Safety Labels

- 1 Label, gas safety warning
- 2 Label, keep cabinet closed warning
- 3 Label, installation guidelines
- 4 Label, general safety warning
- 5 Label, specification

3 Receiving and Storage

3.1 Inspection

All Condair products are shipped F.O.B at the factory. All damage, breakage or loss claims are the responsibility of the shipping company.

After receiving the shipment, inspect the goods as follows:

- Inspect the shipping boxes for damage. Report any shipping box damages to the shipping company without delay.
- Check the goods against the packing slip to ensure that all items have been delivered. Report any shortages to your Condair representative within 48 hours of receipt of the goods. Condair does not assume responsibilities for any shortages beyond this period.
- Unpack the parts/components and check for any damage.
If parts/components are damaged, notify the shipping company immediately.
- Verify the model type on the specification label to ensure that it is suitable for your installation. Refer to ["Model Specifications" on page 12](#).

3.2 Storage and Transportation

Storage

Store the Condair GS humidifier in its original packaging inside a protected area that meets the following requirements until it is installed. These requirements also apply if the unit needs to be stored for an extended period of time.

- Room temperature: 41 to 104°F (5 to 40°C)
- Room humidity: 10 to 75% RH

Transportation

For optimum protection always transport the unit and components in their original packaging, and use appropriate lifting/transporting devices.

Packaging

Keep the original packaging of the unit/components for later use.

If the packaging needs to be disposed off, observe local regulations on waste disposal. Recycle packaging where possible.

4 Product Overview

4.1 General Description

The Condair GS series is a completely new design of gas-fired steam humidifiers. It is designed to provide clean steam humidification at an economical price. The Condair GS humidifier is available in condensing high-efficiency (CS), ultra-low NOx condensing (NX), and Mid-Temperature models in capacities ranging from 50 lb/h to 600 lb/h (23 kg/h to 260 kg/h). The CS, MT and NX models are installed as Category IV appliances.

A high-efficiency GS CS unit operates at maximum efficiency by optimizing fuel combustion. To meet South Coast Air Quality Management District (SCAQMD) requirements, the burners are detuned, resulting in the NX model. This adjustment reduces emissions while maintaining high performance, ensuring compliance with environmental standards.

The Condair GS humidifier comes in two housing styles – compact 50-100 lb/h (23-45 kg/h), and full-size 150-600 lb/h (65-260 kg/h). Refer to [Figure 2](#).

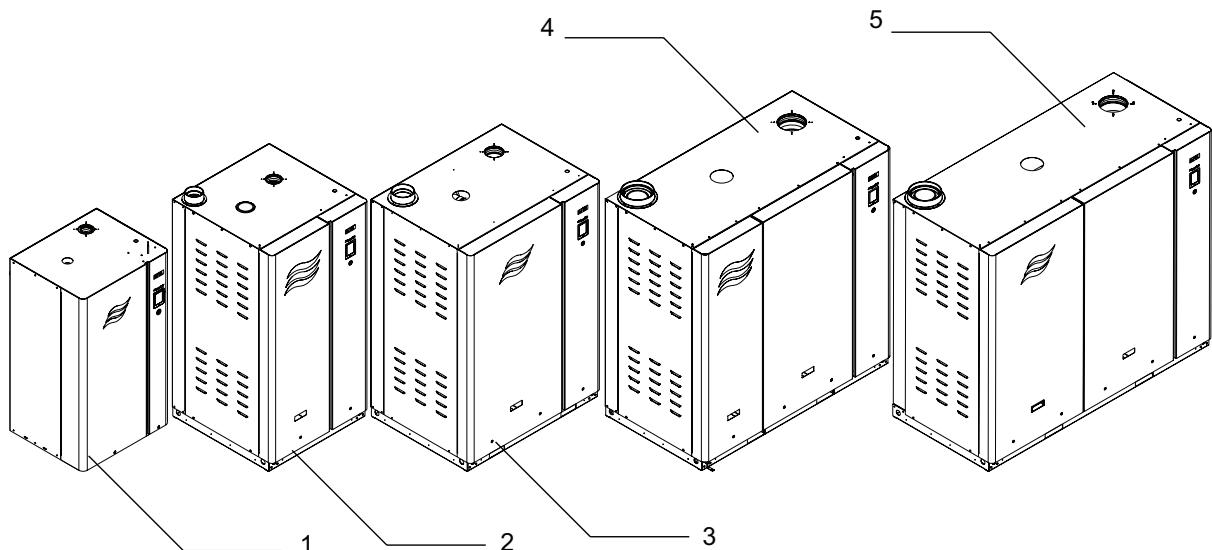


Figure 2: Condair GS-Series II Humidifiers

- | | | | | | |
|---|-------------------------------------|---|--|---|------------------------------------|
| 1 | Condair GS 50/100 (compact housing) | 3 | Condair GS 200/300 (full-size housing) | 5 | Condair GS 600 (full-size housing) |
| 2 | Condair GS 150 (full-size housing) | 4 | Condair GS 450 (full-size housing) | | |

4.2 Model Designation

The specification label on the right side of the Condair GS humidifier shows its model number, serial number and ratings – refer to the figure below.

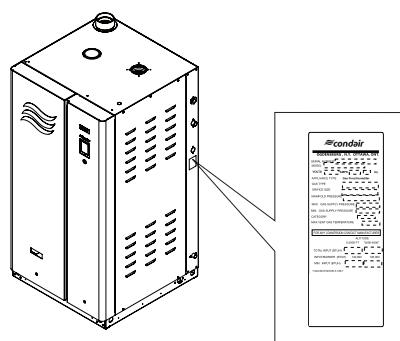


Figure 3: Condair GS-Series II Humidifier Specification Label

The breakdown of the model number is shown below.

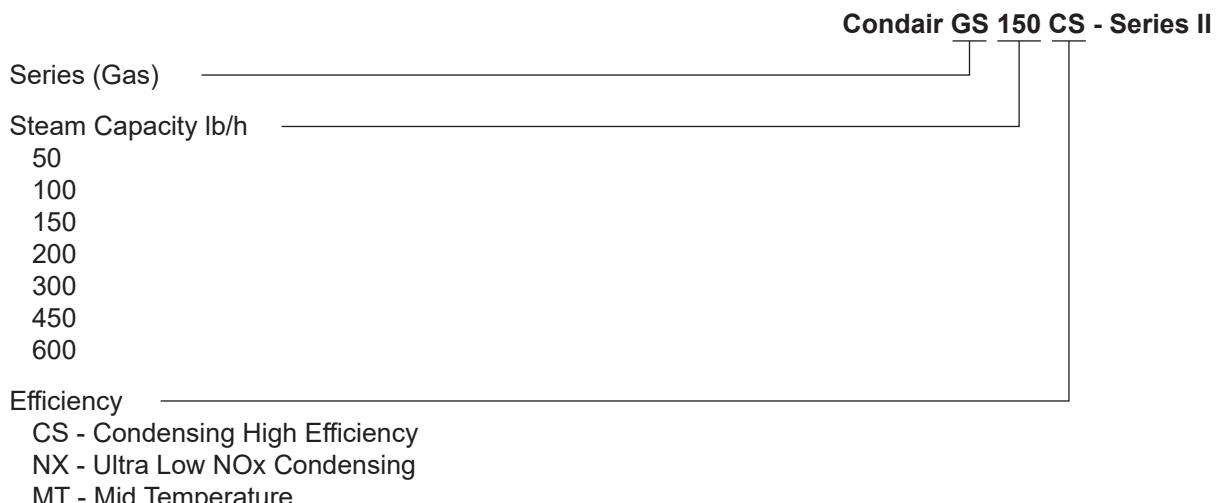


Figure 4: Model Number Breakdown (Example)

4.3 Model Specifications

The tables below list the specifications for the Condair GS humidifier.

Condensing High-Efficiency (CS) Model Specifications

Table 1: Condensing High-Efficiency (CS) Model Specifications

Model	Fuel	Blower Speed	Input BTUh (kW)	Steam Capacity lb/h (kg/h)	Manifold Pressure in H ₂ O (Pa)
Condair GS 50-CS	Natural gas	Maximum	62,000 (18.2)	50 (23)	-0.01 (-2.5)
		Minimum	12,400 (3.6)	10 (4.5)	-0.01 (-2.5)
	Propane	Maximum	62,000 (18.2)	50 (23)	-0.01 (-2.5)
		Minimum	13,000 (3.8)	10 (4.5)	-0.01 (-2.5)
Condair GS 100-CS	Natural gas/ Propane	Maximum	124,000 (36.4)	100 (45)	-0.01 (-2.5)
		Minimum	24,800 (7.3)	20 (9)	-0.01 (-2.5)
Condair GS 150-CS	Natural gas/ Propane	Maximum	186,000 (54.5)	150 (68)	-0.01 (-2.5)
		Minimum	37,200 (10.9)	30 (13.6)	-0.01 (-2.5)
Condair GS 200-CS	Natural gas/ Propane	Maximum	248,000 (72.7)	200 (91)	-0.01 (-2.5)
		Minimum	24,800 (7.3)	20 (9)	-0.01 (-2.5)
Condair GS 300-CS	Natural gas/ Propane	Maximum	372,000 (109.0)	300 (136)	-0.01 (-2.5)
		Minimum	37,200 (10.9)	30 (13.6)	-0.01 (-2.5)
Condair GS 450-CS	Natural gas/ Propane	Maximum	558,000 (163.5)	450 (204)	-0.01 (-2.5)
		Minimum	37,200 (10.9)	30 (13.6)	-0.01 (-2.5)
Condair GS 600-CS	Natural gas/ Propane	Maximum	744,000 (218.0)	600 (272)	-0.01 (-2.5)
		Minimum	37,200 (10.9)	30 (13.6)	-0.01 (-2.5)

Note: On-site conversion kits between propane and natural gas are available for condensing high-efficiency (CS) models.

Ultra-Low NOx Condensing (NX) Model Specifications

Table 2: Ultra-Low NOx Condensing (NX) Model Specifications

Model	Fuel	Blower Speed	Input BTUh (kW)	Steam Capacity lb/h (kg/h)	Manifold Pressure in H ₂ O (Pa)
Condair GS 50-NX	Natural gas	Maximum	65,000 (19.0)	50 (23)	-0.01 (-2.5)
		Minimum	13,000 (3.8)	10 (4.6)	-0.01 (-2.5)
Condair GS 100-NX	Natural gas	Maximum	120,000 (35.2)	100 (45)	-0.01 (-2.5)
		Minimum	26,000 (7.6)	20 (9)	-0.01 (-2.5)
Condair GS 150-NX	Natural gas	Maximum	187,500 (55.0)	150 (68)	-0.01 (-2.5)
		Minimum	39,000 (11.4)	30 (13.6)	-0.01 (-2.5)
Condair GS 200-NX	Natural gas	Maximum	240,000 (70.3)	200 (91)	-0.01 (-2.5)
		Minimum	26,000 (7.6)	20 (9)	-0.01 (-2.5)
Condair GS 300-NX	Natural gas	Maximum	375,000 (109.9)	300 (136)	-0.01 (-2.5)
		Minimum	39,000 (11.4)	30 (13.6)	-0.01 (-2.5)
Condair GS 450-NX	Natural gas	Maximum	562,500 (164.9)	450 (204)	-0.01 (-2.5)
		Minimum	39,000 (11.4)	30 (13.6)	-0.01 (-2.5)
Condair GS 600-NX	Natural gas	Maximum	750,000 (219.8)	600 (272)	-0.01 (-2.5)
		Minimum	39,000 (11.4)	30 (13.6)	-0.01 (-2.5)

Mid-Temperature (MT) Model Specifications

Table 3: Mid-Temperature (MT) Model Specifications

Fuel	Blower Speed	Input BTUh (kW)	Steam Capacity lb/h (kg/h)	Manifold Pressure in H ₂ O (Pa)
Model Condair GS 50-MT				
Natural gas	Maximum	70 000 (20.5)	50 (23)	-0.01 (-2.5)
	Minimum	14 000 (4.1)	10 (4.6)	-0.01 (-2.5)
Model Condair GS 100-MT				
Natural gas	Maximum	140 000 (41.0)	100 (45)	-0.01 (-2.5)
	Minimum	28 000 (8.2)	20 (9)	-0.01 (-2.5)
Model Condair GS 150-MT				
Natural gas	Maximum	210 000 (61.5)	150 (68)	-0.01 (-2.5)
	Minimum	42 000 (12.3)	30 (13.6)	-0.01 (-2.5)
Model Condair GS 200-MT				
Natural gas	Maximum	280 000 (82.1)	200 (91)	-0.01 (-2.5)
	Minimum	28 000 (8.2)	20 (9)	-0.01 (-2.5)
Model Condair GS 300-MT				
Natural gas	Maximum	420 000 (123.1)	300 (136)	-0.01 (-2.5)
	Minimum	42 000 (12.3)	30 (13.6)	-0.01 (-2.5)
Model Condair GS 400-MT				
Natural gas	Maximum	630 000 (184.6)	450 (204)	-0.01 (-2.5)
	Minimum	42 000 (12.3)	30 (13.6)	-0.01 (-2.5)
Model Condair GS 600-MT				
Natural gas	Maximum	840 000 (246.2)	600 (272)	-0.01 (-2.5)
	Minimum	42 000 (12.3)	30 (13.6)	-0.01 (-2.5)

High Altitude De-rating

All high altitude installations have a de-rating of the input capacity. All Canadian models have an automatic 10% de-rating for installations between altitudes of 2000-4500 ft (610-1372 m). For U.S. models, refer to [Table 4](#) for the applicable de-ratings.

Table 4: High Altitude De-rating

Altitude		De-rating (%)
Feet (ft)	Meters (m)	
0-2000	0-610	0
2001-3000	610-915	8
3001-4000	915-1220	12
4001-4500	1220-1370	16
4501 and higher	1370 and higher	Contact factory

4.4 Options

The table below shows the options for the Condair GS humidifier. Contact your Condair representative for details.

Table 5: Condair GS Series Options

Option	Application
Natural gas or propane	Factory-installed gas valve for using either natural gas or propane in the humidifier. Note: only CS models can be configured for propane. On-site conversion kits between propane and natural gas are available.

4.5 Accessories

The Accessory table shows the accessories for the humidifier. Contact your Condair representative for details.

Table 6: Accessories for the Condair GS Series

Accessory	Application
Steam distributor – ASD, BSD, CSD	Steam distribution system for use in an air duct.
SAM-e steam distribution manifold, and mini SAM-e	Steam distribution system for use in an air duct where reduced absorption distance is required.
Blower pack (remote-mounted)	For direct room humidification or use in conditioned spaces without a built-in air distribution system. The Condair GS can use a remote-mounted blower pack for steam distribution (blower pack ordered as an accessory). Larger Condair GS units require multiple blower packs.
Digital or analog control humidistat with either On/Off or modulating operation	Input device used to meter the output of the humidifier based on the sensed relative humidity. The humidistat can be installed in the conditioned space that is being humidified, or within the duct.
Digital RH transducer	Input device used to communicate the relative humidity in a conditioned space or a duct to the humidifier.
Digital or analog high limit humidistat with either On/Off or modulating operation	Input device used to limit the output of the humidifier by either shutting it down or throttling it down when the humidity in the duct approaches the high limit.
Air proving switch	Input device to ensure that humidification only occurs when air is moving through the duct.
Outdoor temperature sensor	Input device used to communicate the outdoor temperature to the humidistat so that it can lower the setpoint value during cold weather to prevent condensation on exterior windows/surfaces.
Mounting stand (CS/NX/MT models only)	(Optional for Condair GS 50/100) Stand for independent mounting of the humidifier on the floor.

5 Mounting and Installation Work

5.1 General

Strictly observe all instructions and perform all tasks (including the mounting of the unit and connection of the gas, flue gas, water, steam and power supplies) as described in this manual.

Adhere to all local and national codes dealing with gas, combustion air, flue gas, water, steam and electrical installations. In the absence of local codes, the installation must conform to the ANSI Z223.1, National Fuel Gas Code, and/or CSA B149.1 codes.

Condair GS-Series II does not accept any liability for installation of humidification equipment by unqualified personnel, or the use of equipment/parts that are not authorized by Condair.

Qualification of personnel

All installation work must be performed only by licensed personnel authorized by the customer. It is the customer's responsibility to verify qualifications of the personnel.

Safety

Observe the following safety precautions:



DANGER!

Risk of explosion and fire!

The Condair GS-Series II is a gas-fired humidifier. Improper installation, adjustment, alteration, service, maintenance or use can cause carbon monoxide poisoning, explosion, fire or other hazards that can cause serious injury, death or property damage. If assistance is required, contact a qualified installer, service agency or your local gas supplier.

Use only factory-authorized and listed kits or accessories when installing or modifying this appliance.



DANGER!

Risk of electric shock!

The Condair GS-Series II humidifier is mains powered. Live parts may be exposed when the access panels are removed. Touching live parts may cause severe injury or even death.

Prevention: The Condair GS-Series II humidifier must be connected to the mains only after all installation work has been completed, checked for correct workmanship, and the access panels are installed properly and fastened securely.



CAUTION!

Risk of damage to internal components from electrostatic discharge (ESD)!

The electronic components inside the humidifier are sensitive to electrostatic discharge (ESD).

Prevention: Take appropriate measures to protect the electronic components inside the unit against damage caused by electrostatic discharge (ESD). Refer to ANSI/ESD-S20.20.

5.2 Installation Overview

5.2.1 Typical Installation – Compact Units

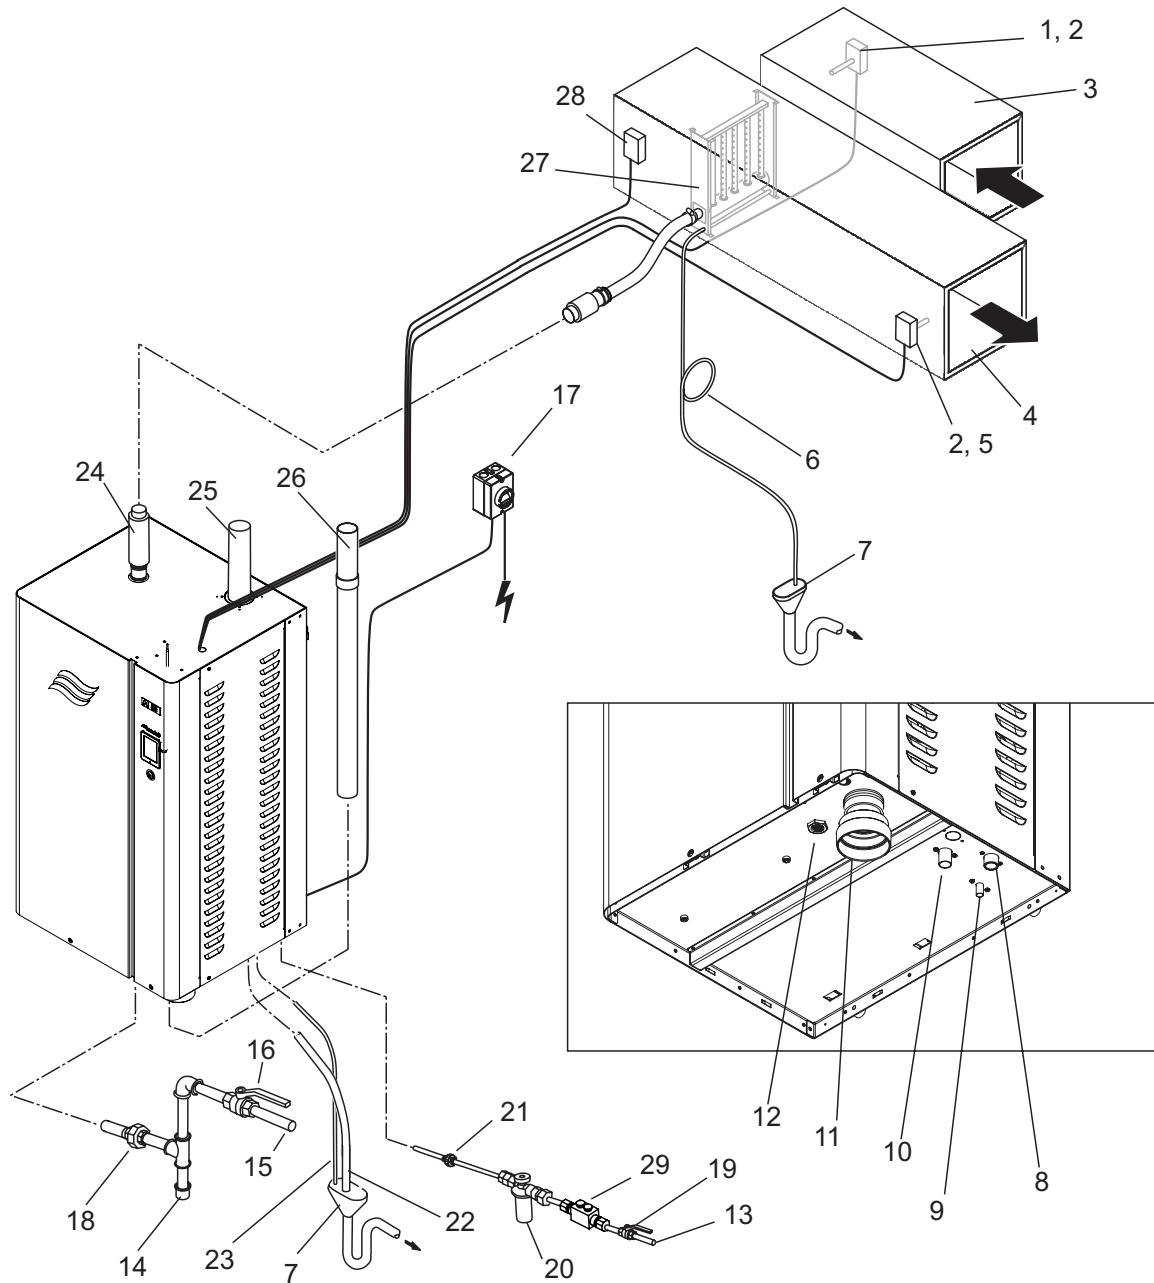


Figure 5: Installation Overview – Compact Unit

- | | | | |
|----|--|----|--|
| 1 | Humidistat, On/Off (for humidity control) | 12 | Inlet, gas |
| 2 | Humidity sensor or modulating humidistat (used for control of the space in the return duct, high limit in the supply duct) | 13 | Supply line, water |
| 3 | Duct, return air | 14 | Trap, sediment |
| 4 | Duct, supply air | 15 | Supply line, gas |
| 5 | Humidistat, On/Off, high limit (external security loop) | 16 | Valve, manual gas shutoff |
| 6 | Drain line, condensate (with trap) | 17 | Switch, disconnect, electrical fused (dedicated) |
| 7 | Funnel, air gap (with optional trap) (supplied by others) | 18 | Fitting, union |
| 8 | Inlet, water | 19 | Valve, water shutoff |
| 9 | Outlet, condensate drain | 20 | Filter, water (optional, but recommended) |
| 10 | Outlet, drain | 21 | Fitting, union |
| 11 | Inlet, intake air | 22 | Drain line |
| | | 23 | Drain line, exhaust condensate (CSNX model only) |
| | | 24 | Steam line |
| | | 25 | Vent, exhaust (connected to exterior) |
| | | 26 | Vent, air intake (connected to exterior – optional) |
| | | 27 | Distributor, steam |
| | | 28 | Switch, air proving (external security loop) |
| | | 29 | Double check valve backflow preventer (supplied by others) |

5.2.2 Typical Installation – Full-Size Units

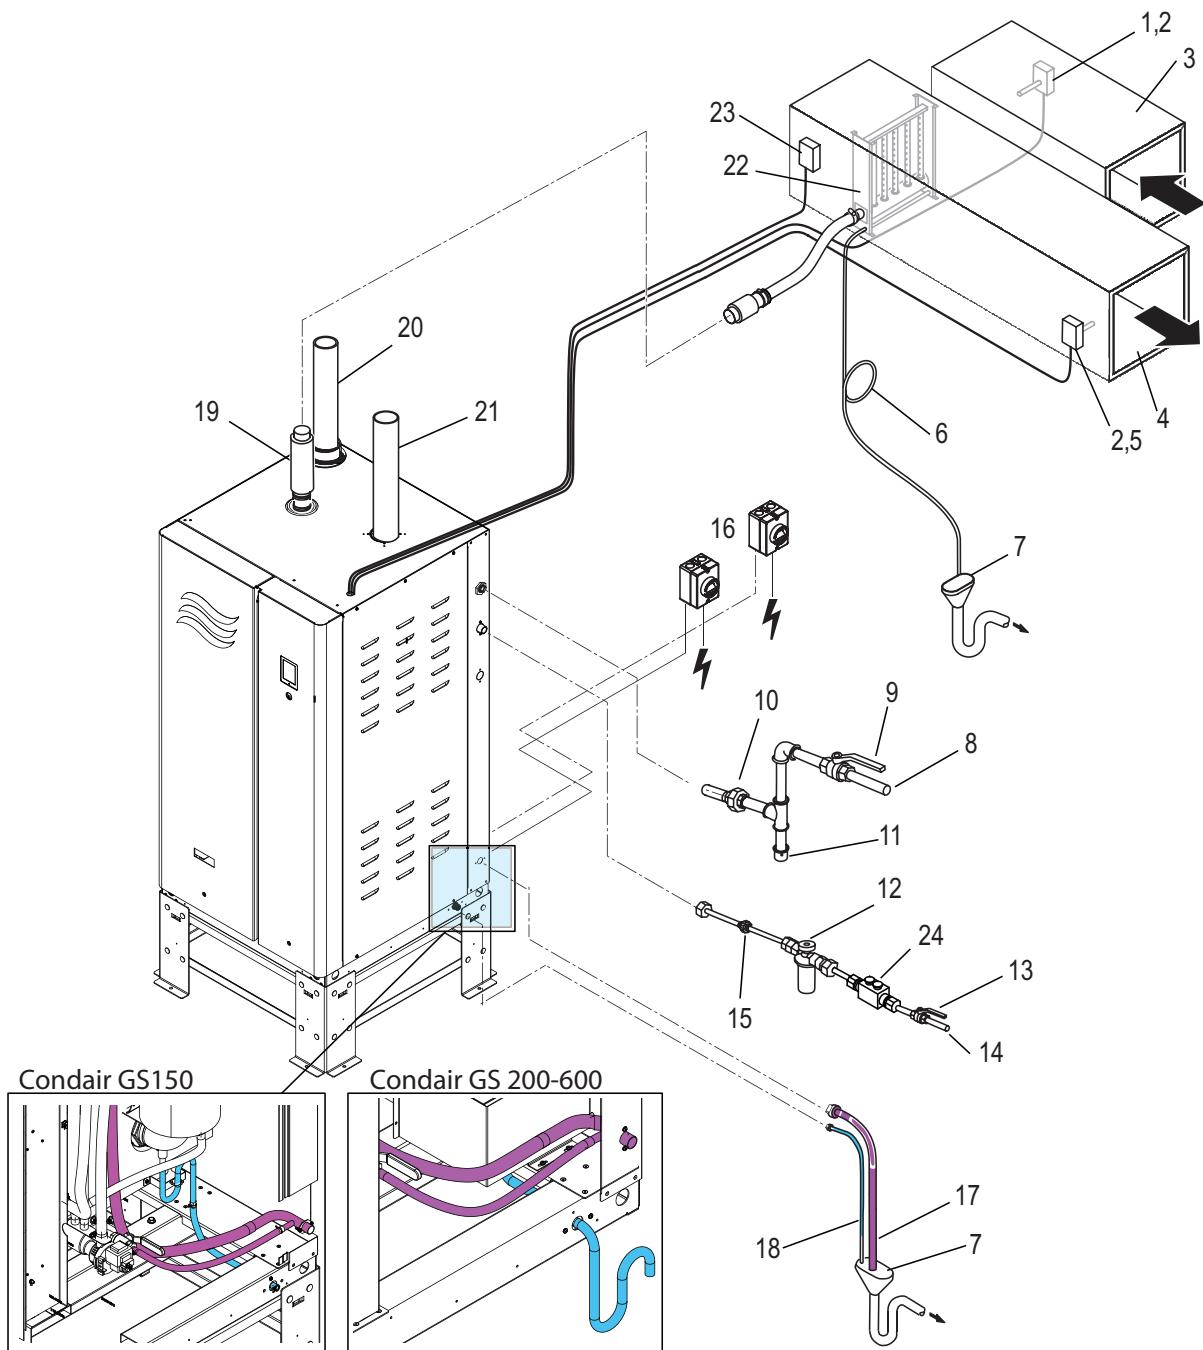


Figure 6: Installation Overview – Full-Size Units (Condair GS 150 Shown)

- | | | | | | |
|---|--|----|--|----|--|
| 1 | Humidistat, On/Off (used for humidity control) | 9 | Manual gas shutoff valve | 20 | Vent, air intake (connected to exterior – optional) |
| 2 | Humidity sensor or modulating humidistat (used for control of the space in the return duct, high limit in the supply duct) | 10 | Fitting, union | 21 | Vent, exhaust vent (connected to exterior) |
| 3 | Duct, return air | 11 | Trap, sediment | 22 | Distributor, steam |
| 4 | Duct, supply air | 12 | Filter, water (optional, but recommended) | 23 | Switch, air proving (external security loop) |
| 5 | Humidistat, On/Off, high limit (external security loop) | 13 | Valve, water shutoff | 24 | Double check valve backflow preventer (supplied by others) |
| 6 | Drain line, condensate (with trap) | 14 | Supply line, water | | |
| 7 | Funnel, air gap (with optional trap) (supplied by others) | 15 | Fitting, union | | |
| 8 | Supply line, gas | 16 | Switch, disconnect, electrical fused (dedicated) | | |
| | | 17 | Drain line | | |
| | | 18 | Drain line, exhaust condensate (CSNX model only) | | |
| | | 19 | Steam line | | |

5.3 Site Requirements

In preparation for installation of the Condair GS humidifier ensure that the following site requirements are satisfied. Report any discrepancies to the site engineer.

Steam and Condensate Lines

- The location of the Condair GS humidifier is largely dependent on the location of the steam distributor, the exhaust vent pipe and the air intake pipe. To minimize heat loss through the steam line, choose the location of the humidifier so that it is as close as possible to the steam distributor.
- Keep the length of the steam line as short as possible. When possible, install the humidifier below the steam distributor. Make sure that the selected location permits proper routing of steam and condensate lines. Refer to ["Best Practices for Installing Steam and Condensate Lines" on page 27](#) for details.

Mounting

- The space in which the humidifier is to be installed must allow adequate clearances for ease of maintenance, and must be easily accessible for servicing. Refer to ["Clearances" on page 20](#) for the required and suggested clearances. Adhere to all local and national installation codes or regulations. Condair is not responsible for any installation code violations.
- The Condair GS humidifier is designed to be floor-mounted, with the exception of the Condair GS 50/100 unit which may also be mounted on the wall. The Condair GS 150/600 units comes with a mounting stand. The Condair GS 50/100 comes with a wall mount and floor stand. The floor must be level if mounting the unit on the floor.
- If wall-mounting the compact unit, choose a wall or other suitable vertical surface that offers a sufficiently high load-bearing capacity – refer to maximum operating weight in ["Overall Dimensions and Weight" on page 22](#).
- In addition, the mounting surface must be able to withstand temperatures of 140-158 °F (60-70 °C) that can be generated during operation of the humidifier. Care must also be taken to ensure that the unit is not mounted above sensitive equipment or walkways.
- Do not mount the humidifier on wooden floors, carpeting or near combustible materials. Adhere to all local and national installation codes or regulations.
- Do not mount the humidifier on vibrating surfaces, or near hot surfaces or surfaces that can freeze.
- The Condair GS humidifier must be installed in a drip-proof location within buildings, where the ambient temperature is 41-104 °F (5-40 °C) and the relative humidity is 5-80% (non-condensing). The selected location must also protect all electrical components in the humidifier from water damage.

Water Supply

- The water supply to the humidifier must be cold potable drinking water, reverse osmosis (RO) water or de-ionized water (DI), with a flow rate of 2.6 gpm (10 l/min) for Condair GS 50-300 unit or 5.3 gpm (20 l/min) for Condair GS 450-600 unit. The water quality requirements are listed in [Table 14](#).
- The water supply line to the humidifier must have a minimum diameter of 1/2 in (12 mm) with a 1/2 in NPT female end. The line must also have a shutoff valve and a union fitting for ease of maintenance.
- For best performance, water temperature should be 34-59 °F (1-15 °C), and maximum temperature must not exceed 77 °F (25 °C).
- The water from the tank may flow back to the water source. To prevent backflow from the unit to the water supply, install a double check valve backflow preventer. Adhere to all local and national installation regulations.
- The water supply should be filtered to 5 µm (optional, but recommended) and pressure regulated to 30-80 psig (207-550 kPa).
- The water supply pipe can be made of plastic that is pressure-proof and certified for use with drinking water systems, copper (not permitted for DI water) or stainless steel (minimum DIN 1.4301).
- The water supply should be free of additives such as corrosion inhibitors, disinfectants, etc., which may affect the performance of the humidifier.

Drainage

- The humidifier should be connected to a dedicated building drain (recommended) with a minimum drainage rate of 5.3 gpm (20 l/min). The drain line must allow free and easy drainage.
- The building drain pipe should be made of a material rated to handle high temperature discharge water at 212 °F (100 °C).
- The space in which the humidifier is to be installed should have a floor drain connected to the building drain. However, if a floor drain is not available, a leakage monitoring device must be supplied to permit interruption of the water supply in case of a leakage. A drain pan is also recommended to prevent property damage.

Combustion Air

- The space in which the humidifier is to be installed must have access to a good supply of clean combustion air at atmospheric pressure. Adhere to appropriate local and national installation regulations for sealed combustion and space air installations.
- The maximum temperature of the combustion air supply should be 386 °F (30 °C).
- For additional requirements for sealed combustion and space air installations refer to ["Combustion Air Connection" on page 37](#).

Exhaust Venting

- The space in which the humidifier is to be installed must permit routing of exhaust air to the outside. Adhere to all local and national installation regulations.
- For additional requirements for the different types of exhaust vent installations refer to ["Exhaust Vent Installation" on page 40](#).

Gas Supply

- Gas supply to the unit must be equipped with a certified manual gas shutoff valve located in the immediate vicinity of the humidifier.
- Thermally actuated gas shut-off device may be installed on the gas line, before the humidifier. Install the device following all local codes and regulations.
- If black pipe is used, a sediment trap (located between the manual shutoff valve and the unit) must also be supplied.
- A capped 1/8 in NPT test port must be supplied in the gas line immediately upstream from the humidifier gas connection.
- A union fitting must be supplied in the gas line immediately upstream from the humidifier gas connection.
- The operating pressure of the gas supply to the humidifier must be as listed in [Table 7](#).

Table 7: Gas Operating Pressure

Gas Type	Operating Pressure in H ₂ O (kPa)	
	Minimum	Maximum
Natural gas (North America)	5 (1.3)	10.0 (2.5)
Propane (North America)	9.0 (2.2)	14.0 (3.5)

- The gas supply line must be sized as listed below. The pipe connection should have male NPT threads.

Table 8: Gas Line Size

Model	Minimum Gas Line Size in (mm)	Gas Inlet Size
Condair GS 50	1/2 (15)	1/2 in NPT (female)
Condair GS 100	1/2 (15)	1/2 in NPT (female)
Condair GS 150	3/4 (20)	3/4 in NPT (female)
Condair GS 200	1 (25)	1 in NPT (female)
Condair GS 300	1 (25)	1 in NPT (female)
Condair GS 450	1-1/4 (32)	1 in NPT (female)
Condair GS 600	1-1/4 (32)	1 in NPT (female)

Power Supply

- The power supply to the humidifier must not exceed the rated current draw indicated on the specification label.
- The power supply must have an external dedicated fused disconnect switch located in the immediate vicinity of the humidifier. The **fusing must be a slow-blow fuse and not exceed the maximum current draw of 15 A.**
- If a remote-mounted blower pack is used for steam distribution, an external 120 VAC, 15 A power source must be supplied.

5.4 Mounting the Humidifier

Before mounting the Condair GS humidifier, refer to ["Site Requirements" on page 18](#) for the location and mounting requirements.

5.4.1 Clearances

The required clearances are listed below. Refer to ["Overall Dimensions and Weight" on page 22](#). Consult local and national installation regulations. Condair does not accept responsibility for violations of the installation codes.

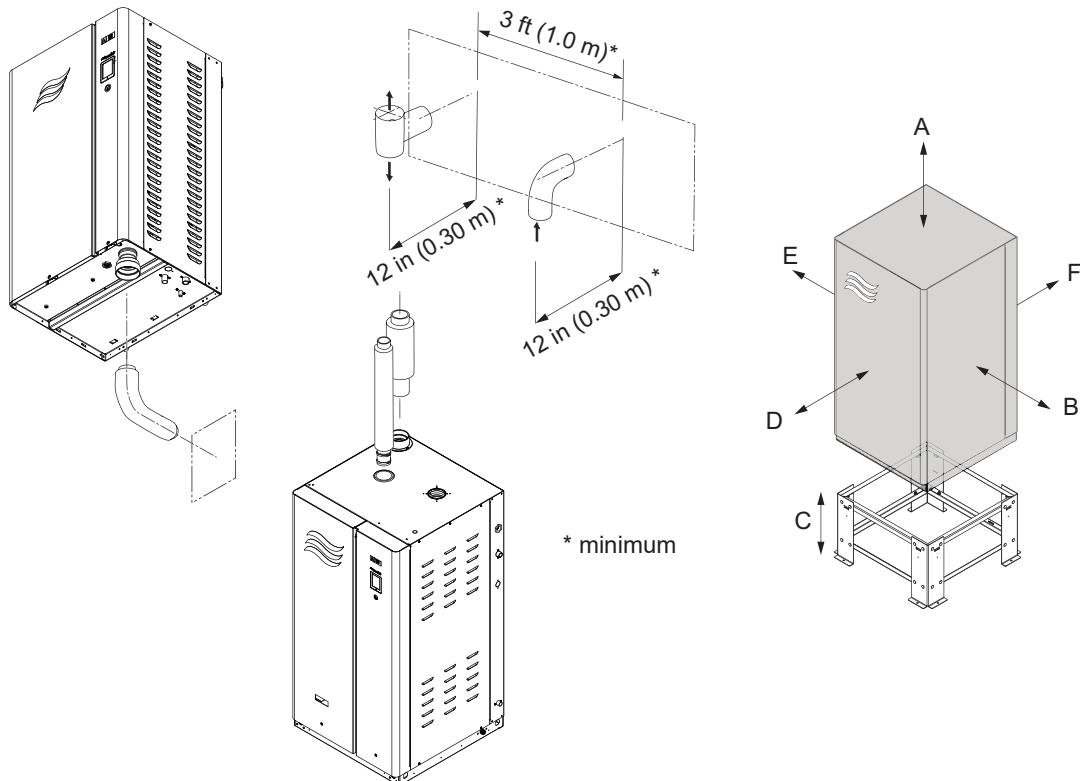


Figure 7: Humidifier Suggested Clearances

Table 9: Required Clearances*

Model	Overhead Clearance "A" in (mm)	Right Side Clearance "B" in (mm)	Floor Stand Height "C" in (mm)	Front Clearance "D" in (mm)	Left Side Clearance "E" in (mm)	Rear Clearance "F" in (mm)
Condair GS 50	16 (406)	24 (610)	26 (670)	36 (914)	0 (0)	0 (0)
Condair GS 100	16 (406)	24 (610)	26 (670)	36 (914)	0 (0)	0 (0)
Condair GS 150	16 (406)	24 (610)	17 (426)**	36 (914)	0 (0)	0 (0)
Condair GS 200	16 (406)	24 (610)	17 (426)	36 (914)	0 (0)	0 (0)
Condair GS 300	16 (406)	24 (610)	17 (426)	36 (914)	0 (0)	0 (0)
Condair GS 450	16 (406)	24 (610)	17 (426)	36 (914)	0 (0)	0 (0)
Condair GS 600	16 (406)	24 (610)	17 (426)	36 (914)	0 (0)	0 (0)

* Consult local and national installation codes.

** The Condair GS 150 may also be floor mounted without the stand.

Table 10: Suggested Clearances (for ease of service and maintenance)

Model	Overhead Clearance "A" in (mm)	Right Side Clearance "B" in (mm)	Floor Stand Height "C" in (mm)	Front Clearance "D" in (mm)	Left Side Clearance "E" in (mm)	Rear Clearance "F" in (mm)
Condair GS 50	36 (914)	30 (762)	26 (670)	36 (914)	0 (0)	0 (0)
Condair GS 100	36 (914)	30 (762)	26 (670)	36 (914)	0 (0)	0 (0)
Condair GS 150	36 (914)	30 (762)	17 (426)	36 (914)	0 (0)	0 (0)
Condair GS 200	36 (914)	30 (762)	17 (426)	36 (914)	0 (0)	0 (0)
Condair GS 300	36 (914)	30 (762)	17 (426)	36 (914)	0 (0)	0 (0)
Condair GS 450	36 (914)	30 (762)	17 (426)	36 (914)	0 (0)	0 (0)
Condair GS 600	36 (914)	30 (762)	17 (426)	36 (914)	0 (0)	0 (0)

5.4.1.1 Overall Dimensions and Weight

The overall dimensions and weight of the Condair GS humidifier are listed below.

Note: The dimensions and weights shown do not include the wall mount bracket. The height of the floor mounting stand (default for Condair GS 200-600, optional for Condair GS 50/100/150) is 16.0 in (406 mm). Refer to ["Product Specifications" on page 72](#).

Table 11: Condair GS Humidifier Overall Dimensions and Weights (includes stands)

Condair GS CS/NX Model	Dimensions in (mm)				Weight lb (kg)		
	Height	Height (with stand)	Width	Depth	Net	Operating	Floor Stand
GS 50-CS/NX	43.3 (1101)	65 (1643)	25.2 (640)	21.4 (542)	177 (80)	368 (167)	47.4 (21.5)
GS 100-CS/NX	43.3 (1101)	65 (1643)	25.2 (640)	21.4 (542)	197 (89)	388 (176)	47.4 (21.5)
GS 150-CS/NX	54.6 (1387)	70 (1788)	28.2 (717)	29.0 (738)	309 (140)	589 (267)	39.7 (18)
GS 200-CS/NX	54.6 (1387)	70 (1788)	40.4 (1026)	29.0 (738)	426 (193)	952 (432)	41.9 (19)
GS 300-CS/NX	54.6 (1387)	70 (1788)	40.4 (1026)	29.0 (738)	437 (198)	963 (437)	41.9 (19)
GS 450-CS/NX	54.6 (1387)	70 (1788)	57.0 (1448)	29.0 (738)	547 (248)	1459 (662)	57.3 (26)
GS 600-CS/NX	54.6 (1387)	70 (1788)	66.9 (1700)	29.0 (738)	821 (372)	1967 (892)	59.5 (27)

Condair GS MT Model	Dimensions in (mm)				Weight lb (kg)		
	Height	Height (with stand)	Width	Depth	Net	Operating	Floor Stand
GS 50-MT	43.3 (1101)	65 (1643)	25.2 (640)	21.4 (542)	161 (73)	352 (160)	47.4 (21.5)
GS 100-MT	43.3 (1101)	65 (1643)	25.2 (640)	21.4 (542)	181 (82)	373 (169)	47.4 (21.5)
GS 150-MT	54.6 (1387)	70 (1788)	28.2 (717)	29.0 (738)	289 (131)	569 (258)	39.7 (18)
GS 200-MT	54.6 (1387)	70 (1788)	40.4 (1026)	29.0 (738)	406 (184)	933 (423)	41.9 (19)
GS 300-MT	54.6 (1387)	70 (1788)	40.4 (1026)	29.0 (738)	417 (189)	944 (428)	41.9 (19)
GS 450-MT	54.6 (1387)	70 (1788)	57.0 (1448)	29.0 (738)	498 (226)	1411 (640)	57.3 (26)
GS 600-MT	54.6 (1387)	70 (1788)	66.9 (1700)	29.0 (738)	772 (350)	1918 (870)	59.5 (27)

5.4.2 Removing the Shipping Pallet

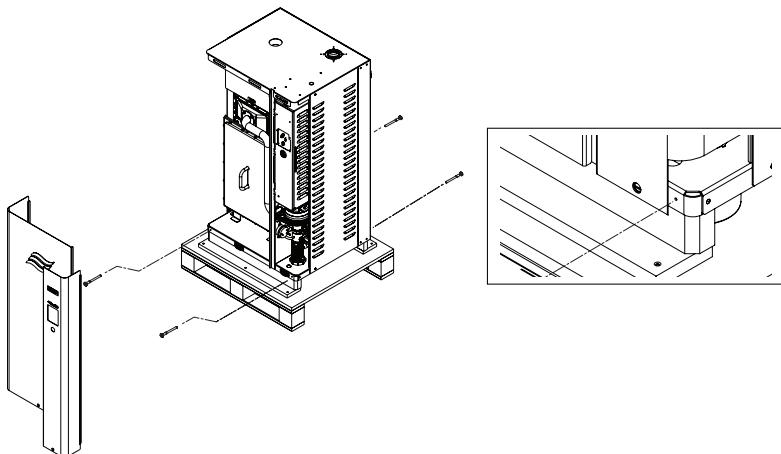


Figure 8: Removing the Shipping Pallet Screws (compact unit shown)

1. Remove the door panels from the humidifier, and remove and discard the shipping screws that secure the unit to the shipping pallet.
2. Lift the humidifier by its base frame and raise it off the shipping pallet. The unit may now be mounted.



WARNING!

Heavy object – risk of personal injury, or damage to equipment!

Prevention: Use an appropriate lifting device to lift the humidifier. Lift the unit from the bottom, and not the side or top panels.

5.4.3 Wall Mounting – Compact Unit Only

(For Condair GS 50/100) Install the compact humidifier on the wall or other suitable vertical mounting surface as follows. Refer to [Figure 9 on page 24](#).

1. Check that the selected mounting location provides adequate clearances for maintenance, and is at an easily servicable height. Refer to ["Clearances" on page 20](#).
2. Ensure that the mounting surface has adequate structural strength to support the operating weight of the unit – refer to ["Overall Dimensions and Weight" on page 22](#) for weights. Condair recommends mounting to 3/4 in (20 mm) thick plywood or equivalent.
3. Open the accessory box supplied and setup the mounting bracket:
 - a. At the desired position on the vertical mounting surface, secure one end of the mounting bracket to the wall using a suitable \varnothing 3/8" (10 mm) screw and a plastic plug.
 - b. Level the mounting bracket, and mark the locations of the remaining attachment points.
 - c. Install \varnothing 3/8" (10 mm) screws and appropriate plastic plugs at the attachment points and secure the mounting bracket to the wall. Ensure the bracket is level before tightening screws.
4. Carefully lift the humidifier by its base frame and raise it off the shipping pallet.
5. Remove door panels of the humidifier, then carefully lower the humidifier onto the mounting bracket that is secured to the wall. Through the back panel, secure the humidifier to the bracket with screws.
6. Reinstall the door panels.

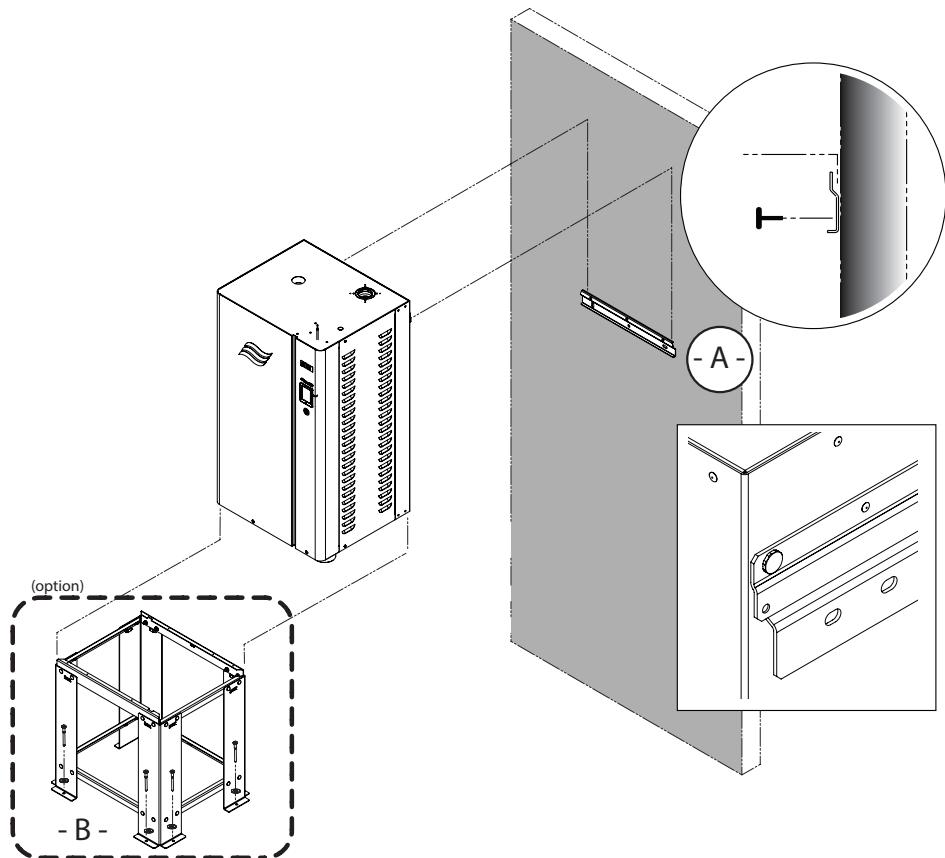


Figure 9: Mounting, Compact Unit. A - Wall mount , B - Floor mount (optional)

5.4.4 Floor Stand Mounting - Compact Unit

(Optional for Condair GS 50/100) The compact unit may be mounted onto the floor with the floor stand option.

Install the humidifier on the floor stand as follows. Refer to [Figure 9 on page 24](#).

1. Ensure mounting location provides clearances for maintenance. Refer to ["Clearances" on page 20](#).
 2. Remove all the packaging material around the humidifier. Remove the accessory box and open its contents. Assemble the floor stand using the instructions in the accessory box.
 3. Make sure that the floor is hard and level, then set the floor stand on the floor (and optionally against a wall or other suitable vertical mounting surface).
- Note:** If desired, remove the leveling screws and secure the stand to the floor with 3/8 in (10 mm) bolts and washers (not supplied).
4. Carefully lift the humidifier by its base frame and raise it off the shipping pallet. Gently lower the humidifier on the stand.



WARNING!

Heavy object – risk of personal injury, or damage to equipment!

Prevention: Use an appropriate lifting device to lift the humidifier. Lift the unit from the bottom, and not the side or top panels.

5. Use 3/8 in (10 mm) bolts and washers to secure the assembly to the floor. Use shims as necessary to ensure a level installation.

5.4.5 Floor Stand Mounting - Full Size unit

The Condair GS 200-600 must be mounted on the floor stand. The Condair GS 150 may also be installed directly onto the floor.




Figure 10: Floor Stand Mounting, Full-Size Units. (Condair GS 150 and Condair GS 450 Shown)

Install the full-size humidifier on the stand as follows.

1. Ensure mounting location provides clearances for maintenance. Refer to ["Clearances" on page 20](#).
2. Remove all the packaging material around the humidifier. Remove the accessory box and open its contents. Assemble the floor stand using the instructions in the accessory box.
3. Place the floor stand at the desired position on the floor. Use shims to level the stand (as necessary) and if desired, secure the stand to the floor with 3/8 in (10 mm) bolts.
4. Carefully lift the humidifier by its base frame and raise it off the shipping pallet. Gently lower the humidifier on the floor stand.



WARNING!

Heavy object – risk of personal injury, or damage to equipment!

Prevention: Use an appropriate lifting device to lift the humidifier. Lift the unit from the bottom, and not the side or top panels

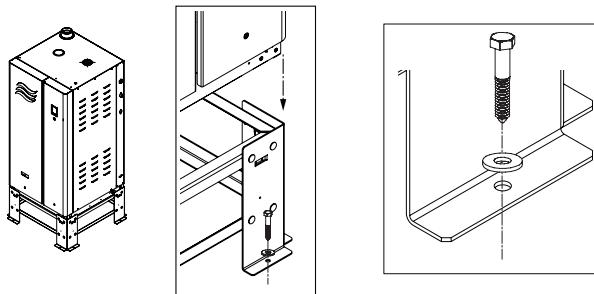


Figure 11: Floor Stand Mounting, Securing the Stand to the Floor (Condair GS 150 Shown)

5.4.6 Mounting Checklist

Check the following to ensure that the humidifier has been mounted correctly:

- Unit installed in the correct location (according to ["Clearances" on page 20](#))?
- Adequate clearance for servicing unit?
- Mounting surface stable, and capable of supporting the full operating weight of the humidifier?
- Unit level and secured properly?

5.5 Steam Connection

Steam generated by the humidifier can be distributed into a conditioned space through an air handling unit (AHU) using Condair steam distributors, blower packs or Condair SAM-e steam distribution manifolds – refer to their respective manuals for installation details.

Refer to ["Site Requirements" on page 18](#) for the steam and condensate line installation requirements.

5.5.1 Installing the Main Steam Pipe

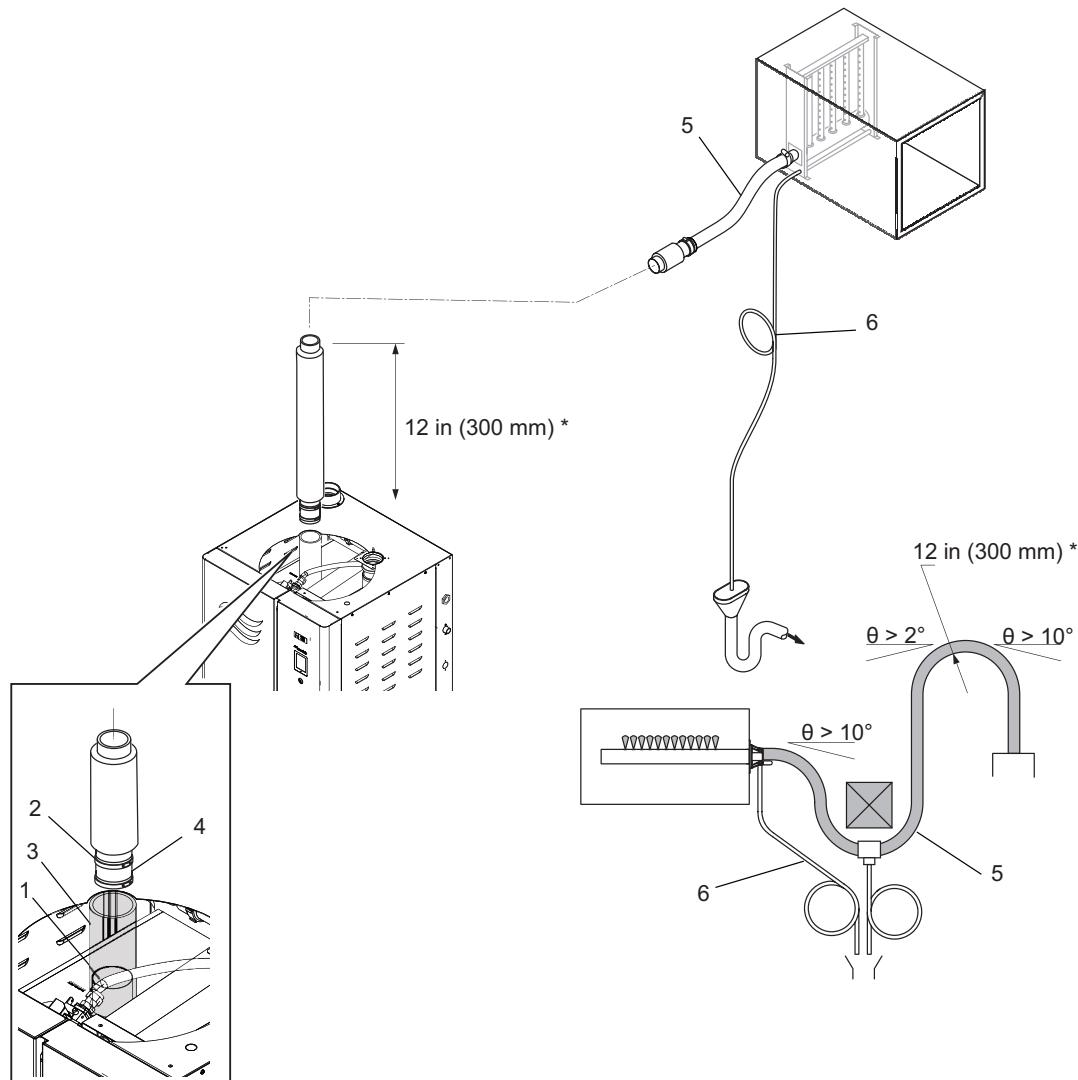


Figure 12: Main Steam Line Installation

- | | | | | | |
|---|--|---|--|---|---|
| 1 | Steam outlet, humidifier | 4 | Cuff, hose (supplied) | 6 | Drain line, condensate – must have minimum downslope of 1.2°. The trap should be minimum 12 in (300 mm) in diameter, and located minimum 12 in (300 mm) below the steam distributor or dip in the steam line. |
| 2 | Clamp, gear (supplied) | 5 | Steam hose – must have minimum bend radius of 12 in (300 mm), and minimum upslope of 10° or minimum downslope of 2° to steam distributor. Steam hose must not sag – add condensate drain line, as shown, if necessary. | | |
| 3 | Steam pipe, rigid (main) – must rise straight up minimum 12 in (300 mm) above steam outlet before continuing to steam distributor. Refer to Table 13 on page 27 for maximum equivalent length of steam line. | | | | |

5.5.2 Best Practices for Installing Steam and Condensate Lines

Condair recommends that you observe the following best practices for installing atmospheric steam lines and condensate lines.

Steam Line

- Use rigid steam pipe made of copper (MED Type-L) or stainless steel (minimum DIN 1.4301) exclusively. Steam pipes made of any other materials may adversely affect the operation of the unit, and will void the warranty.
- Refer to [Table 12](#) for the required minimum internal diameter of the steam pipe. The internal diameter of the steam pipe can be expanded, but once expanded a reduction in diameter is not permitted, except at the steam distributor.

Table 12: Steam Pipe Diameter

Model	Copper MED Type L Nominal Pipe Size in (mm)	Stainless Steel Nominal Tube Size in (mm)	Steam Loss in Condensation Copper MED Type L lb/ft (kg/m)		Equivalent Steam Line Length ft (m)		Max. Allowable Backpressure in H ₂ O (kPa)
			Uninsulated	Insulated	Max.	Recommended Max.	
Condair GS 50	1.5 (38)	1.75 (45)	0.10 (0.15)	0.03 (0.04)	50 (14)	20 (6)	6 (1.49)
Condair GS 100	1.5 (38)	1.75 (45)	0.10 (0.15)	0.03 (0.04)	70 (21)	20 (6)	6 (1.49)
Condair GS 150	3 (76)	3 (76)	0.16 (0.24)	0.04 (0.06)	100 (30)	33 (10)	10 (2.49)
Condair GS 200	3 (76)	3 (76)	0.16 (0.24)	0.04 (0.06)	120 (37)	33 (10)	10 (2.49)
Condair GS 300	3 (76)	3 (76)	0.16 (0.24)	0.04 (0.06)	150 (46)	33 (10)	10 (2.49)
Condair GS 450	4 (102)	4 (102)	0.20 (0.30)	0.05 (0.07)	180 (55)	33 (10)	10 (2.49)
Condair GS 600	4 (102)	4 (102)	0.20 (0.30)	0.05 (0.07)	230 (79)	33 (10)	10 (2.49)

- The backpressure in the line, in addition to the duct static pressure, **MUST NOT EXCEED** the maximum allowable backpressure, as indicated in the table above.
- The length of the steam line should be kept as short as possible. It should not exceed the maximum equivalent length shown in [Table 12](#). Exceeding the maximum length can affect performance of the unit, and may void the warranty. Also refer to [Table 13 on page 27](#) for equivalent length of typical steam line fittings. Turns, elbows, and other directional changes in the steam line over a short span reduce the steam flow rate and cause backpressure to exceed the maximum allowable limit, even if the equivalent line length in [Table 12](#) is maintained.
- Use long radius elbows for steam pipes and avoid 90° bends. This minimizes backpressure and formation of condensation.

Table 13: Equivalent Length of Typical Steam Line Fittings

Nominal Tube Size in (mm)	Standard 90° Elbow ft (m)	Standard 45° Elbow ft (m)	Side-Outlet Tee ft (m)
1.75 (45)	3.5 (1.1)	1.75 (0.5)	7 (2.1)
3 (75)	5 (1.5)	2.5 (0.8)	11 (3.4)
4 (100)	8 (2.4)	4 (1.2)	15 (4.6)

IMPORTANT! When determining the length and routing of steam lines, allowances must also be made for thermal expansion. Allowances must also be made for shrinkage in the length of the steam hose due to aging

- The steam line from the humidifier must lead straight upwards for a minimum of 12 in (300 mm), before continuing on to the steam distribution system – refer to [Table 13 on page 27](#). The steam line must have a minimum upslope of 10°, or a minimum downslope of 2° to the steam distributor – refer to [Figure 13 on page 28](#).

- Use only Condair steam hose between the steam outlet on the humidifier and the steam distributor. Other types of steam hoses can affect performance of the unit, and may void the warranty. The **minimum bend radius of the steam hose is 12 in (300 mm)**. The steam hose must not sag, and must have a minimum upslope of 10°, or a minimum downslope of 2° to the steam distributor.
- Use short lengths of steam hose to connect the steam line to the humidifier or steam distributor. Secure the steam hoses with gear clamps.
- Use short lengths of steam hose to connect the steam line to the humidifier or steam distributor. Secure the steam hoses with gear clamps.



CAUTION!

Risk of damage to the gear clamp.

Do not over-tighten the gear clamp. The maximum torque value for gear clamps is 16 in·lbs (180 N·cm).

- Do not combine multiple steam lines, except at the steam distributor. Use a Condair adaptor specifically designed for that purpose, and only if the humidifiers connected to the adaptor operate in parallel.
- To minimize formation of condensation, the steam pipe must be insulated with a minimum of 1 in (25 mm) of pipe insulation over its entire length.
- The weight of the steam pipe must be supported so there is no load on the humidifier.



WARNING!

Risk of severe burns from contact with hot steam vapors!

Restrictions in the cross-section of the steam line will cause excessive backpressure in the steam tank when the unit is operating, which may cause unexpected release of hot steam vapors. Bare skin exposed to the hot steam vapors can result in severe burns. In addition, excess backpressure also affects performance of the unit.

Prevention: Observe the following:

- Upon completion of the installation, clean the steam line to remove any contaminants and installation materials.
- The steam hose (if used) must not have any kinks or other restrictions.
- To prevent condensate pockets, the steam line must not sag. If necessary, support the steam line with pipe clamps, trough, or wall brackets, and install a condensate drain at the lowest point in the steam line.
- **DO NOT** install a shutoff valve (e.g. a manually operated shutoff valve, solenoid valve, etc.) in the steam line.

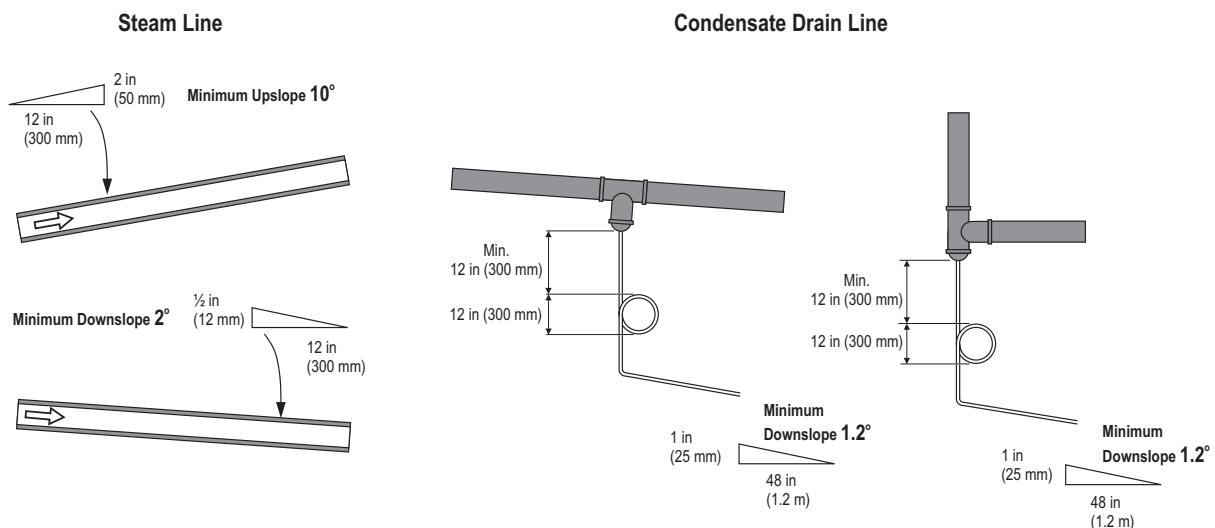


Figure 13: Steam and Condensate Line

Condensate Lines

- Use 1/2 in (13 mm) Condair condensate hose, or 1/2 in (13 mm) stainless steel pipe or copper pipe for condensate lines and traps



WARNING!

Risk of severe burns from contact with hot fluids or steam!

The condensate lines may be filled with hot fluids or steam. Bare skin in contact with hot fluids or steam can result in severe burns.

Prevention: Never plumb the condensate lines to empty into a sink used by personnel. Always connect the lines to a floor drain according to applicable national and local plumbing codes.

- Condensate traps must also be installed at all low points and at horizontal-to-vertical transitions in the steam line. The condensate drain lines should always connect to full-size "Tee" connectors in the steam line. Refer to [Figure 13 on page 28](#).
- The condensate lines must have a minimum downslope of 1.2°, with a minimum 12 in (300 mm) diameter condensate trap, and connect to the building floor drain with condensate cooler (if required). The condensate trap must be at least 12 in (300 mm) below the condensate "Tee" and the steam distributor.
- For a steam line that is longer than 15 ft (4.5 m) up to the maximum recommended length, install condensate lines and traps at regular intervals. The maximum distance between condensate lines for long runs is 15 ft (4.5 m).
- Condensate lines must have individual traps before emptying to a common condensate drain. The common condensate drain must be sized appropriately to handle all the condensate.
- Make sure that the condensate lines allow proper flow.
- Do not over-tighten the hose clamps on the condensate lines.

IMPORTANT! Before starting up the unit, prime the condensate traps with water.

5.5.2.1 Common Steam and Condensate Line Installation Mistakes

Some common steam and condensate line installation mistakes are shown in [Figure 14 on page 30](#).

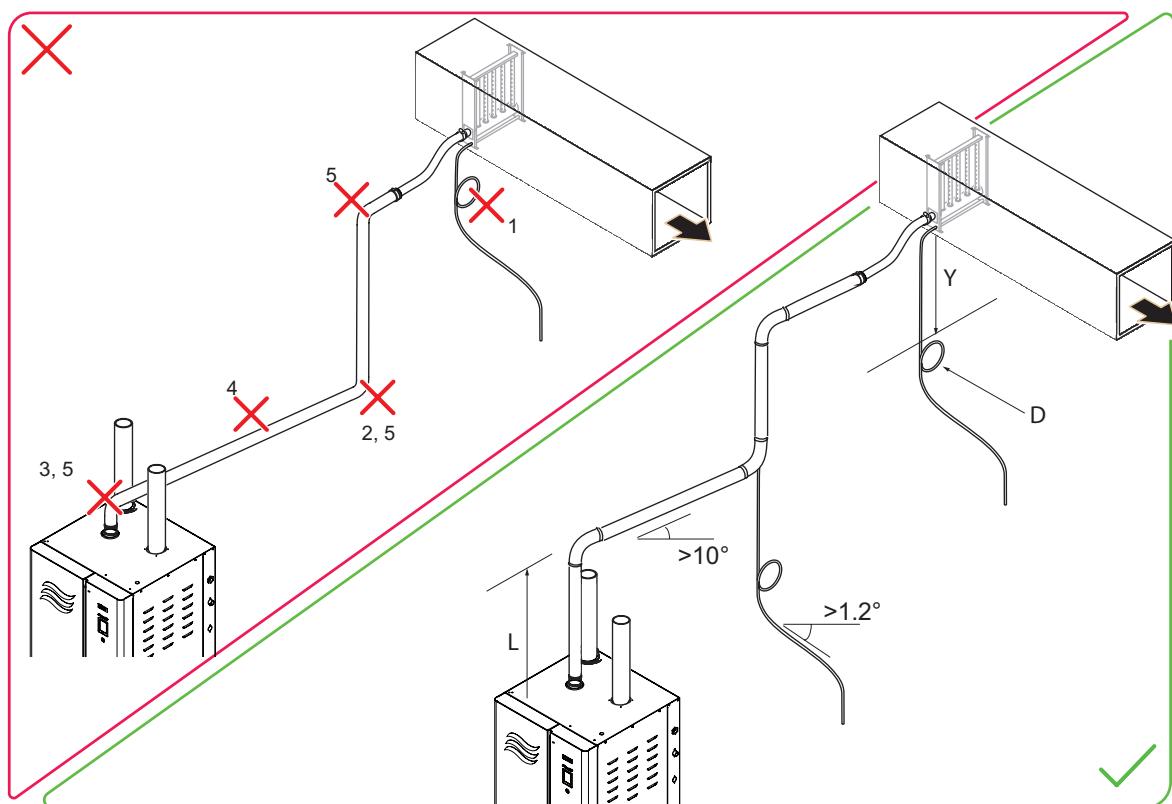


Figure 14: Common Steam and Condensate Line Installation Mistakes

- 1 The condensate trap is located less than the required minimum 12 in (300 mm) below the steam distributor.
 - 2 No condensate trap is installed at the horizontal-to-vertical transition.
 - 3 The steam line does not run straight up for the required minimum 12 in (300 mm) before continuing on to the steam distributor.
 - 4 Steam line is not sloped – upslope minimum 10° downslope minimum 2° is not maintained.
 - 5 The required long radius elbow (for rigid pipe) is not used.
- D Diameter of condensate trap (minimum) is 12 in (300 mm).
- L Vertical steam line distance from the humidifier is 12 in (300 mm) (minimum).
- Y Condensate trap distance below the steam distributor is 12 in (300 mm) (minimum).

5.5.3 Steam Connection Checklist

Check the following to ensure that the steam connections for the humidifier have been installed correctly:

Steam Line

- Observed all best practices?
- Steam pipe sized correctly?
- The steam line does not exceed maximum equivalent length listed in [Table 13 on page 27](#)?
- Long radius elbows (for rigid pipes) used?
- Backpressure in the line combined with duct static pressure does not exceed 6 in H₂O (1.49 kPa) for compact units, or 10 in H₂O (2.49 kPa) for full-size units?
- Steam line runs straight up from the humidifier steam outlet for at least 12 in (300 mm) before bend?
- Steam line has minimum upslope of 10°, or minimum downslope of 2°?
- Steam line does not reduce in diameter except at the steam distributor; and condensate line installed just before the restriction?
- Steam lines do not merge except at the steam distributor through a Condair adaptor?
- Steam line does not sag?
- Steam connections secured with clamps? Clamps torqued adequately?
- Allowances made for thermal expansion of rigid pipes, and shrinkages of steam hose?
- Steam line insulated over its entire length?

Condensate Line

- Local regulations on drain water temperature requirements have been satisfied?
- Condensate traps installed at all low points, and at horizontal-to-vertical transitions in the steam line?
- Condensate lines in the steam line always connect to full-size "Tee" connectors?
- Condensate traps have a minimum loop diameter of 12 in (300 mm) and installed at least 12 in (300 mm) below the condensate "Tee" and the steam distributor?
- All condensate lines have a minimum downslope of 1.2°?
- Condensate traps installed at regular intervals on long runs exceeding 15 ft (4.5 m)?
- Condensate lines have individual traps before emptying to a common condensate drain? Condensate drain sized appropriately to handle all the condensate?
- Condensate traps primed with water?

5.6 Water Installation

Refer to ["Site Requirements" on page 18](#) for the water supply and drain requirements. Read ["Notes on Water Connections" on page 34](#), and perform the water connections as shown in [Figure 15](#).

5.6.1 Water Connections

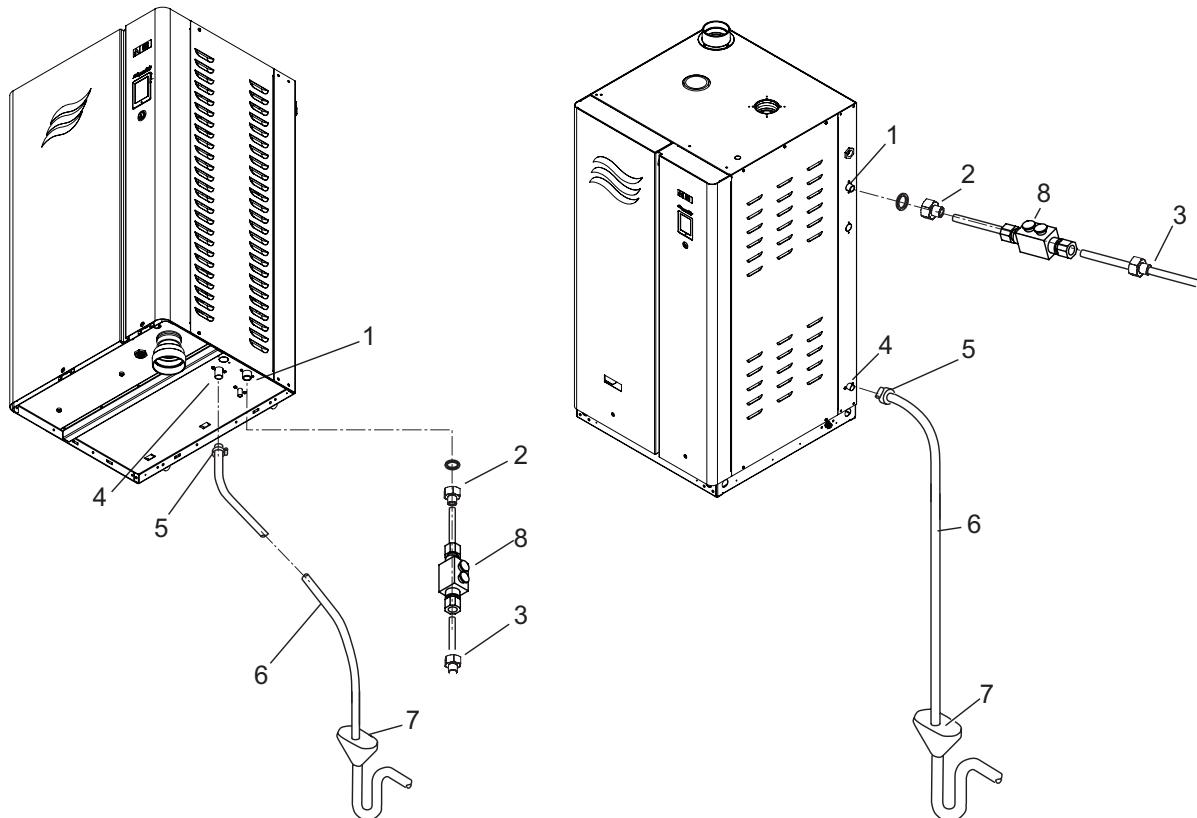


Figure 15: Water Connections (Condair GS 50/100 and Condair GS 150 shown)

- | | | | | | |
|---|---|---|---|---|---|
| 1 | Inlet, fill valve – 3/4 in BSPP
(plastic thread) | 4 | Outlet, drain, 1 in (25 mm) O.D.
(unthreaded) | 7 | Funnel, air gap – should be minimum
2-1/2 in (64 mm) diameter, and drain pipe
connected to it should have minimum
diameter of 1-1/2 in (38 mm). Must be
located within 3 ft (1 m) from the unit (or
according to code) |
| 2 | Adaptor, 3/4 in BSPP to 1/2 in NPT
(supplied) | 5 | Clamp, hose (not supplied) | 8 | Double check valve backflow preventer
(supplied by others) |
| 3 | Supply line, water – minimum 1/2 in
(13 mm) diameter | 6 | Hose, drain – minimum downslope
of 1.2°, and must not touch sides or
bottom of funnel | | |

5.6.2 Installing Exhaust Condensate Drain Line (CS/NX Model Only)

Install the exhaust condensate drain line (CS/NX model only) as shown in [Figure 16](#).

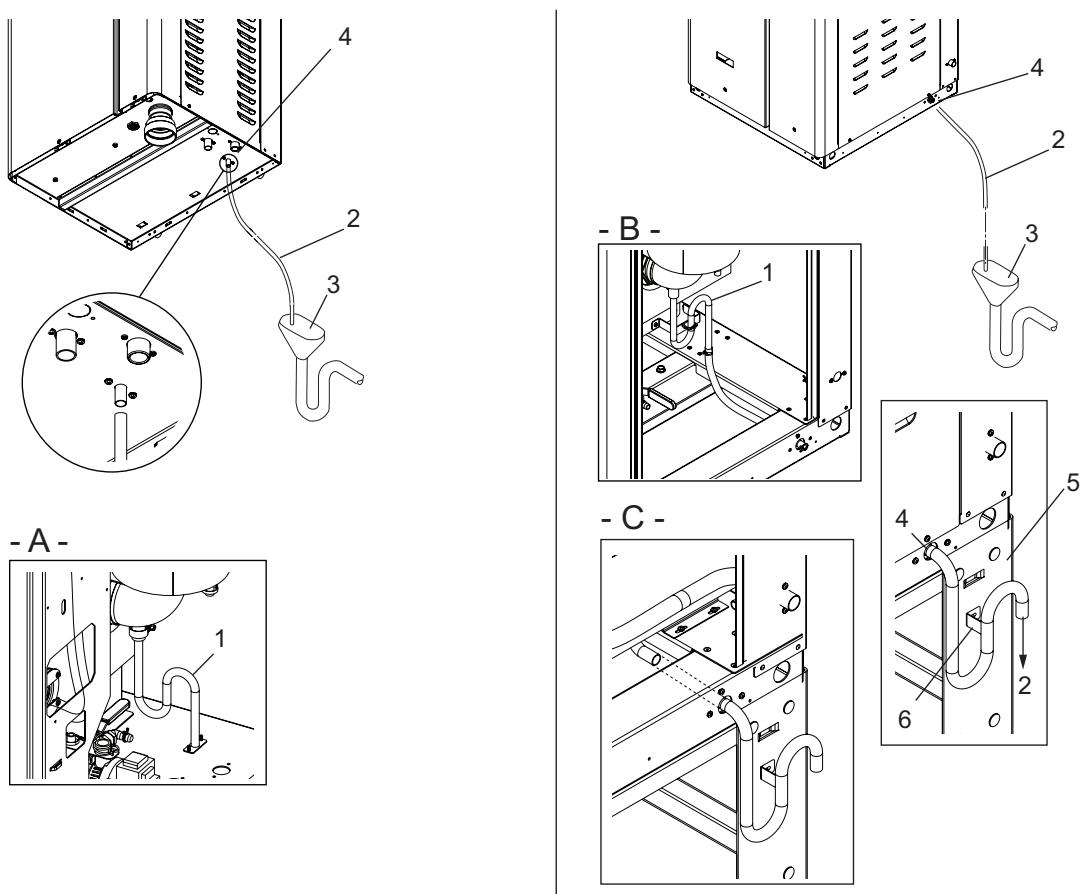


Figure 16: Exhaust Condensate Drain Line.

A - Condair GS 50-100, B - Condair GS 150, C - Condair GS 200-600.

- 1 Trap, internal condensate (Condair GS 50-150) – primed with water
- 2 Hose, drain, exhaust condensate – (not supplied) must have minimum downslope of 1.2°, and must not touch sides or bottom of funnel. Use Condair condensate hose.
- 3 Funnel, air gap – funnel must be located below the condensate outlet and within 3 ft (1 m) of the unit (or according to code)
- 4 Outlet, condensate drain
- 5 Floor stand (default for Condair GS 150-600)
- 6 Bracket, p-trap to floor stand

5.6.3 Notes on Water Connections

Water Supply

The water supply installation is to be carried out according to [Figure 15 on page 32](#) and the applicable local plumbing codes.

- Admissible water supply pressure regulated to 30-80 psig (207-550 kPa)
- Admissible water supply temperature is 34-77 °F (1-25 °C). Recommended temp.: 34-60 °F (1-15 °C)
- Notes on water quality:
 - The water supply to the humidifier must be cold potable drinking water, reverse osmosis (RO) water or de-ionized water (DI), with a flow rate of 10 l/min for Condair GS 50 - 300 unit or 20 l/min for Condair GS 450 - 600 units. The water quality must meet the requirements listed below.

Table 14: Water Quality Requirements

Water Type	Hardness gpg (PPM)	pH	Chloride PPM *	Conductivity $\mu\text{S}/\text{cm}$	Silica PPM
Potable	0 - 20.42 (0 - 350)	6.5 - 8.5 **	0-40	1-1500	0-14
Treated	0-0.99 (0-17)	7.0 - 8.5 **	0-40	1-100	0-1

* Damage caused by chloride corrosion is not covered by your Condair warranty.

** If pH is >7.5 and the content of Sodium and/or sulfates are also high, the risk of foaming is increased.

- The use of **additives** such as corrosion inhibitors, disinfectants, etc. is **not allowed**, since these additives may endanger health and affect proper operation.
- Condair GS units come with a sacrificial anode installed as standard. The anode is a crucial component in protecting the tank and heat exchanger from corrosion. Made from a more reactive metal, the anode is installed on the door and corrodes instead of the tank or heat exchanger, thereby extending their lifespan. This process, known as cathodic protection, ensures that the anode sacrifices itself to prevent more critical components from deteriorating.
- The water supply piping to the humidifier should have a minimum internal diameter of 1/2 in (12 mm) with a 1/2 in NPT female end. The water supply pipe can be made of plastic (pressure-proof to 100 psig (690 kPa) and certified for use with drinking water systems), copper (not permitted for DI water) or stainless steel (minimum DIN 1.4301).
- For ease of maintenance, a water shutoff valve and union fitting must be installed in the supply line before the humidifier.
- If a water filter is used (optional, but recommended), it must be installed as close as possible to the humidifier.
- If water hammers cannot be avoided in the supply line, a water shock arrestor must be installed.
- **Important! The water supply line must be well flushed out before being connected to the unit.**



CAUTION!

Risk of damage to the plastic threads in the fill valve!

Prevention: Hand-tighten the NPT adaptor to the fill valve. The thread at the humidifier connection (inlet) is made of plastic.

Water Drain

The water drain is to be installed according to [Figure 15 on page 32](#) and the applicable local plumbing codes.

- The drain hose from the humidifier should be as short as possible, and empty into the air gap funnel without touching its sides or bottom. Drain hose must have a minimum constant downslope of 1.2° and must be secured with a hose clamp. The drain hose must be rated for 212 °F (100 °C).
- Attach the drain hose in such a way that it cannot slip out of the funnel.
- The air gap funnel (with trap) in the floor should be located away (max 3 ft (1 m) from the unit) from the control cabinet to keep any rising steam from damaging the electrical components in the control cabinet. The diameter of the air gap funnel should be minimum 2-1/2 in (64 mm).
- The drain pipe connecting the air gap funnel to the building drain should have a minimum inner diameter of 1-1/2 in (38 mm). Use stainless steel (minimum DIN 1.4301) or copper pipe (not permitted for DI water).
- The building waste water installation (including funnel and trap) should be made of a material rated to handle high temperature discharge water at 212 °F (100 °C).
- Upon completion of installation, disconnect and flush the water supply and drain lines to clear out any debris in the lines. Check the strainer in the fill valve is free of all debris. Reconnect the lines.
- **Drain water cooling reduces the drain water exiting the unit to 140 °F (60 °C).**

Exhaust condensate drain

The exhaust condensate drain is to be installed according to [Figure 16 on page 33](#) and the applicable local plumbing codes.

- Install the condensate drain hose (CS/NX model only), and secure it with a hose clamp – refer to [Figure 16 on page 33](#). The hose must be rated to 212 °F (100 °C). Connect the hose to a condensate neutralization device, if required by local code, before connecting the hose to a drain.
- Prime the condensate trap inside the unit (CS/NX model only) with water.

5.6.4 Water Connections Checklist

Check the following to ensure that the water connections for the humidifier have been installed correctly:

- Water supply
 - Water quality meet the requirements listed in [Table 14 on page 34](#)?
 - Filter valve (or shutoff valve and 125µm filter) and union fitting installed in supply line close to the humidifier?
 - Double check valve backflow preventer is installed along the water supply line to the unit? Is the double check valve backflow preventer installed, adhering to all applicable local and national installation regulations?
 - Water supply piping to humidifier minimum 1/2 in (13 mm) diameter?
 - Are pressure-proof materials, certified for use with drinking water systems, used? Copper or stainless steel if using potable drinking water or RO water? Plastic or stainless steel pipe if using DI water?
 - 5 µm water filter (optional, but recommended) installed in the supply line close to the humidifier?
 - Water supply temperature 34-60 °F (1-15 °C)? Do not exceed 77 °F (25 °C).
 - Water supply pressure regulated to 30-80 psig (207-550 kPa) and surge-protected?
 - Water supply system tight?
 - Water supply line flushed? Strainer in the fill valve free of debris?
- Water drain
 - Air gap (open drain) funnel in the floor located away (max 3 ft (1 m) from the unit) from the control cabinet in the humidifier?
 - Air gap funnel minimum 2-1/2 in (64 mm) in diameter?
 - Drain pipe between air gap funnel and building drain have a minimum internal diameter of 1-1/2 in (38 mm)?
 - Copper or stainless steel pipe if using potable drinking water or RO water? Stainless steel pipe if using DI water?
 - Drain hose from humidifier empty into the air gap (open) funnel without touching its sides or bottom?
 - Drain hose have a minimum constant downslope of 1.2°, and secured with hose clamp?
 - Drain hose rated for 212 °F (100 °C)?
 - Water drain line flushed?
- Exhaust condensate drain (CS models only)
 - Condensate hose installed (CS/NX model only)? Hose rated for 212 °F (100 °C)?
 - Condensate trap inside unit primed with water?
 - Water supply line and drain lines flushed? Strainer in the fill valve free of debris?

5.7 Combustion Air Connection

Combustion air provisioning must meet the requirements stated in Sections 5.3 of the National Fuel Gas Code (ANSI Z223.1) in the USA, or Sections 7.2, 7.3, 7.4 of the CAN/CGA B149 Installation Codes in Canada, or applicable provisions of the local building codes

Excess exposure to contaminated combustion air will result in safety and performance-related problems with the humidifier. Known contaminants include: halogens, ammonia, and chlorides, excessive dust, lime or dirt. Excess exposure to these contaminants will also affect the on-board electronics. Contact Condair if you have any questions. If necessary, isolate the unit from the contaminated space.

Refer to ["Site Requirements" on page 18](#) for combustion air requirements.

Select the type of installation required for combustion air – refer to ["Space Air Installation" on page 37](#) or ["Sealed Combustion Installation" on page 38](#), as applicable.

5.7.1 Space Air Installation

This type of installation draws combustion air from inside the room/space where the humidifier is installed. Refer to [Table 15](#) for the required minimum cross-sectional area for the fresh air intake in the room/space. An appropriate opening to the outside of the building must be provided to allow fresh combustion air into the space. Adhere to all local and national installation regulations.

Note: Condair requires installing an elbow (fitted with a screen) at the intake air inlet on all Condair GS 150-600 (full size) units to prevent dirt and debris from being drawn into the combustion chamber. Seal the connection with silicone sealant. Keep the area around the air intake clear of all obstructions. Refer to [Table 16 on page 38](#) for outside diameter of elbow.

Table 15: Room Fresh Air Intake Cross-sectional Area

Model	Minimum Cross-sectional Area in ² (cm ²)
Condair GS 50	8 (50)
Condair GS 100	13 (88)
Condair GS 150	18 (120)
Condair GS 200	23 (150)
Condair GS 300	35 (225)
Condair GS 450	53 (350)
Condair GS 600	71 (460)

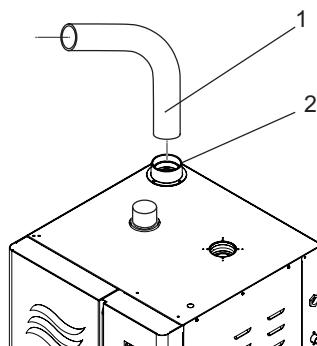


Figure 17: Space Air Installation – GS 150-600

- 1 Elbow, fitted with screen (not supplied).
- 2 Intake air inlet (full-size unit)

5.7.2 Sealed Combustion Installation

A sealed combustion installation draws fresh combustion air from the outside. Sealed combustion requirements for combustion air are governed by national and local installation codes, as stated at the beginning of this section. The vent diameter listed in [Table 16](#) must be maintained over the entire length of the vent. Adhere to all local and national installation codes.

In addition, refer to ["Sealed Combustion Installation Requirements" on page 39](#).

Table 16: Air Intake Vent Diameter

Condair Model	Intake Vent Diameter in (mm)
GS 50	2 (50)
GS 100 * / GS 150 *	3 (75)
GS 200 / GS 300	4 (100)
GS 450 / GS 600	6 (150)

* Requires 3 in (75 mm) adapter

Figure 18 shows the sealed combustion connection for the compact and full-size Condair GS humidifiers.

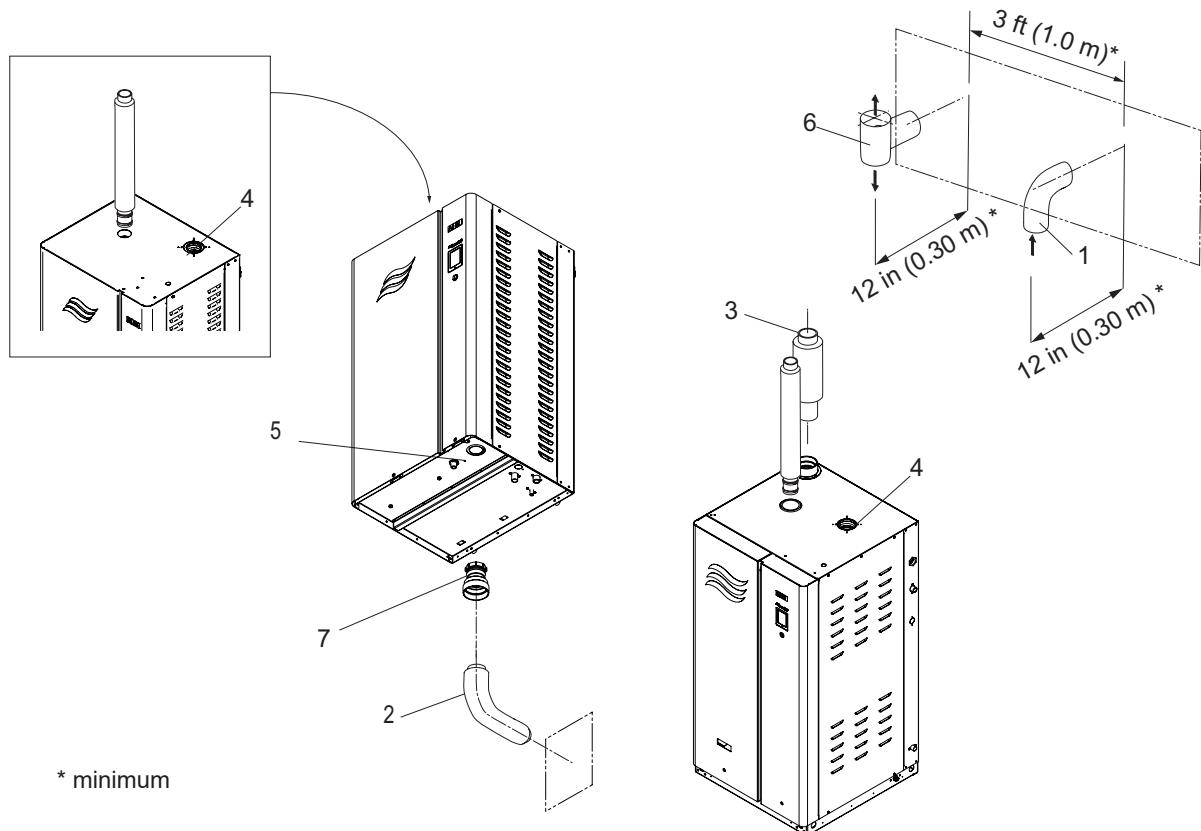


Figure 18: Sealed Combustion Connection (compact shown left)

- | | | | | | |
|---|---|---|---|---|--|
| 1 | Air intake terminal (elbow) – terminal located outside building and facing down (not supplied), 12 in (30cm) from wall. | 2 | Air intake – wrapped with insulation (not supplied) | 6 | Exhaust gas terminal ("Tee") – terminal located outside building and opening vertical (not supplied), 12in (30cm) from wall. |
| | | 3 | Intake air inlet (full-size unit) | | |
| | | 4 | Exhaust gas outlet | | |

Sealed Combustion Installation Requirements

In addition to the requirements of the applicable national and local codes for sealed combustion installations, the following requirements must also be satisfied:

- The intake vent must not exceed an equivalent length of 100 ft (30 m), except for the Condair GS 50 using propane gas which is limited to 50 ft (15 m).
Note: Each 90° bend is equal to 10 ft (3 m) of straight pipe, and each 45° bend is equal to 5 ft (1.5 m) of straight pipe. The intake vent should not have more than six bends.
- The intake vent diameter is listed in [Table 16 on page 38](#). The vent diameter must remain uniform over the entire run.
- Intake vent pipes can be made of stainless steel, ABS, PVC, CPVC or poly-propylene. All joints and seams must be sealed with an appropriate sealant.

IMPORTANT! Route the intake vent so that it does not obstruct access to any of the services to the humidifier. On the compact unit, make sure that the maintenance access for the drain pump is not obstructed.

- The intake vent must be supported every 5 ft (1.5 m), and at every pipe bend.
- An intake (elbow) terminal must be installed on the outside termination of the air intake vent, with the elbow facing down – refer to [Figure 18 on page 38](#). The location and spacing between the air intake terminal and exhaust vent terminal must comply with all local and national regulations, with at least a minimum spacing of 3 ft (1 m) between them.
- At low temperatures, water condensation can occur on the outside of the air intake vent. To prevent this, Condair suggests adding in-line heating and insulation on the intake vent.

5.7.3 Combustion Air Checklist

Check the following to ensure that the combustion air connection for the humidifier has been installed correctly:

- Combustion air requirements for the type of installation selected meet all national and local regulations?

Space Air Installation

- Fresh combustion air requirements for the room/space (see [Table 15 on page 37](#) and all national and local regulations) satisfied?
- Elbow installed at the intake air inlet on full size units (not Condair GS 50/100)?

Sealed Combustion Installation

- All relevant national and local regulations for sealed combustion installation satisfied?
- Intake vent length does not exceed an equivalent length of 100 ft (30 m)? If unit is Condair GS 50 using propane gas, is it limited to 50 ft (15 m)? Maximum six bends used?
- Vent diameter as listed in [Table 16 on page 38](#), and uniform over the entire run?
- All joints and seams sealed with appropriate sealant?
- Intake vent correctly supported?
- Spacing between air intake terminal and exhaust vent terminal minimum 3 ft (1 m)?
- Intake vent heated and insulated in cold climates?

5.8 Exhaust Vent Installation

The Condair GS CS/NX model uses a condensing type exhaust venting system, and must be installed as a Category IV appliance. The MT model can be installed as a Category IV appliance.

The general requirements and the different exhaust venting types are discussed in "[General Requirements](#)".

5.8.1 General Requirements

The exhaust vent system used with the Condair GS series humidifier must satisfy the following general requirements:

The exhaust vent systems shall be certified to UL or UL/CSA standard, and meet the installation requirements in Part 7 (Venting of Equipment) of the National Fuel Gas Code (ANSI Z223.1) in the USA, or Section 7 (Venting Systems and Air Supply for Appliances) of the CAN/CGA B149 Installation Codes in Canada, or applicable provisions of the local building codes. Any local regulations related to exhaust venting systems must also be adhered to.

In applying the codes, refer to the vent system manufacturer's instructions, the local gas supplier regulations, and the specific instructions in this manual.

This appliance must be installed in compliance with national regulations and codes. The installation must only be performed by a qualified technician who is well versed with these codes and the local requirements of the jurisdiction.

Proper removal of combustion gases must be assured, and building materials must be protected from degradation by flue gases.

Never mix venting types. Never use two different manufacturer's equipment for the same exhaust vent.

All exhaust vent terminations must be fitted with a rain cap. For CPVC venting, a tee with horizontal exhaust is preferred. Alternatively a goose neck down (90 + 45 degrees) is acceptable (adhere to all national or local codes). Exhaust terminations can be excluded from the equivalent length calculations.

All horizontal exhaust vent runs must maintain a constant minimum upslope of 2° to prevent accumulation of condensate.

All horizontal runs must be adequately supported every 5 ft (1.5 m) to prevent sagging, with support at every bend.

When an exhaust vent run exceeds 20 ft (6.1 m), insulate the exhaust vent pipe to reduce the amount of condensate that could form in the flue gases.

When an exhaust vent passes through a cold area or a location that has large amounts of air flow over the vent, insulate the exhaust vent pipe to prevent condensation inside the vent.

When an exhaust vent passes through walls, floors, and ceilings, proper clearances must be maintained around combustible materials and venting manufacturer's fire stop equipment.

The exhaust vent shall not pass through any air circulation duct or plenum.



WARNING!

Risk of severe burns from contact with hot exhaust vent!

Prevention: Install a screen or barrier around the exhaust vent to prevent contact with it.

- Exhaust condensate management is required on all Condair GS (CS and NX models) installations. Refer to ["Installing Exhaust Condensate Drain Line \(CS/NX Model Only\)" on page 33](#).

IMPORTANT! Before starting up the unit, prime all condensate traps with water.

- Never vent into an un-lined masonry or concrete chimney unless the chimney is sized and installed according to the provisions of the national fuel code in the USA (ANSI Z223.1) or the Canadian standards (CSA B149).
 - A chimney or exhaust vent should extend at least 3 ft (1 m) above the roof, and at least 2 ft (0.6 m) above any ridge within 10 ft (3 m) of the chimney. Local codes apply. The exhaust vent must terminate at a sufficient height above the roof to prevent blockage due to accumulation of snow.
 - All exhaust vents must be made of corrosion-resistant materials, and all sealing materials must be tested and approved for exhaust venting systems.
 - The exhaust vent must be secured with hangers or pipe straps. All horizontal runs must be adequately supported with hangers or straps to prevent sagging.
 - The exhaust vent must not exceed an equivalent length of 100 ft (30 m), except for the Condair GS 50 using propane gas which is limited to 50 ft (15 m).
 - The vent run should be as direct as possible with no more than six elbows in the system.
- Note:** Each 90° elbow is equivalent to 10 ft (3 m), and each 45° elbow is equivalent to 5 ft (1.5 m) of straight pipe.
- [Table 17](#) lists the diameter of the exhaust vent. The vent diameter must remain uniform over the entire run. Adhere to all local and national installation codes.

Table 17: Exhaust Vent Details - CS/NX/MT

	Model	Appliance Category	Exhaust Outlet size	Exhaust Vent Diameter	Vent Type
CS/NX	Condair GS 50-CS/NX	Category IV	60 mm*	2 in	CPVC or 3 in BH (stainless steel)
	Condair GS 100-CS/NX	Category IV	80 mm*	3 in	
	Condair GS 150-CS/NX	Category IV	80 mm*	3 in	
	Condair GS 200-CS/NX	Category IV	100 mm*	4 in	
	Condair GS 300-CS/NX	Category IV	100 mm*	4 in	
	Condair GS 450-CS/NX	Category IV	150 mm*	6 in	
	Condair GS 600-CS/NX	Category IV	150 mm*	6 in	
MT	Condair GS 50-MT	Category IV	3 in	3 in	Type BH (stainless steel)
	Condair GS 100-MT	Category IV	3 in	3 in	
	Condair GS 150-MT	Category IV	3 in	3 in	
	Condair GS 200-MT	Category IV	4 in	4 in	
	Condair GS 300-MT	Category IV	4 in	4 in	
	Condair GS 450-MT	Category IV	6 in	6 in	
	Condair GS 600-MT	Category IV	6 in	6 in	

- * The exhaust outlet on the CS/NX unit has a female connection (metric size). Each unit is supplied with a metric to imperial adaptor (with internal seals) to accommodate imperial vent sizes.

Sidewall Venting Requirements

The following additional requirements of the National Fuel Gas Code (ANSI Z223.1), or CAN/CGA B149 Installation Codes must be satisfied if the exhaust vent terminates through a sidewall:

- Locate the humidifier as close as possible to the wall that is used for termination of the vent.
- Locate the exhaust terminal at least 3 ft (1 m) above any forced air inlet located within 10 ft (3 m); or at least 4 ft (1.2 m) below, and 4 ft (1.2 m) horizontally from, or 12 in (300 mm) above any door, window, or gravity air inlet into any building.
- Maintain a minimum horizontal clearance of 4 ft (1.2 m) from electric meters, gas meters, regulator and relief equipment.
- Install certified vent terminals at the vent terminations.
- Locate the vent terminal at least 7 ft (2.1 m) above grade when it is adjacent to public walkways.
- Locate the bottom of the vent terminal at least 12 in (300 mm) above grade or ground, or normally expected snow accumulation level. The snow level may be higher on walls exposed to prevailing winds.
- Avoid areas where experience shows that condensate drip may cause problems – such as above planters, patios, or over public walkways, or over an area where condensate or vapor could create a nuisance or hazard, or could be detrimental to the operation of regulators, relief valves, or other equipment. Refer to the vent manufacturer's installation instructions.
- The vent terminal must be installed in the same atmospheric pressure zone as the combustion air inlet for the humidifier. If that is not possible (as in cases of positive or negative room pressures), sealed combustion must be utilized.

[Figure 19 on page 43](#) and [Figure 20 on page 44](#) show the general types of venting arrangements. These are guidelines only. For the specific venting arrangements refer to ["Installation as a Category IV Appliance" on page 45](#), and ["Gas Connection" on page 47](#). Adhere to all national or local codes.

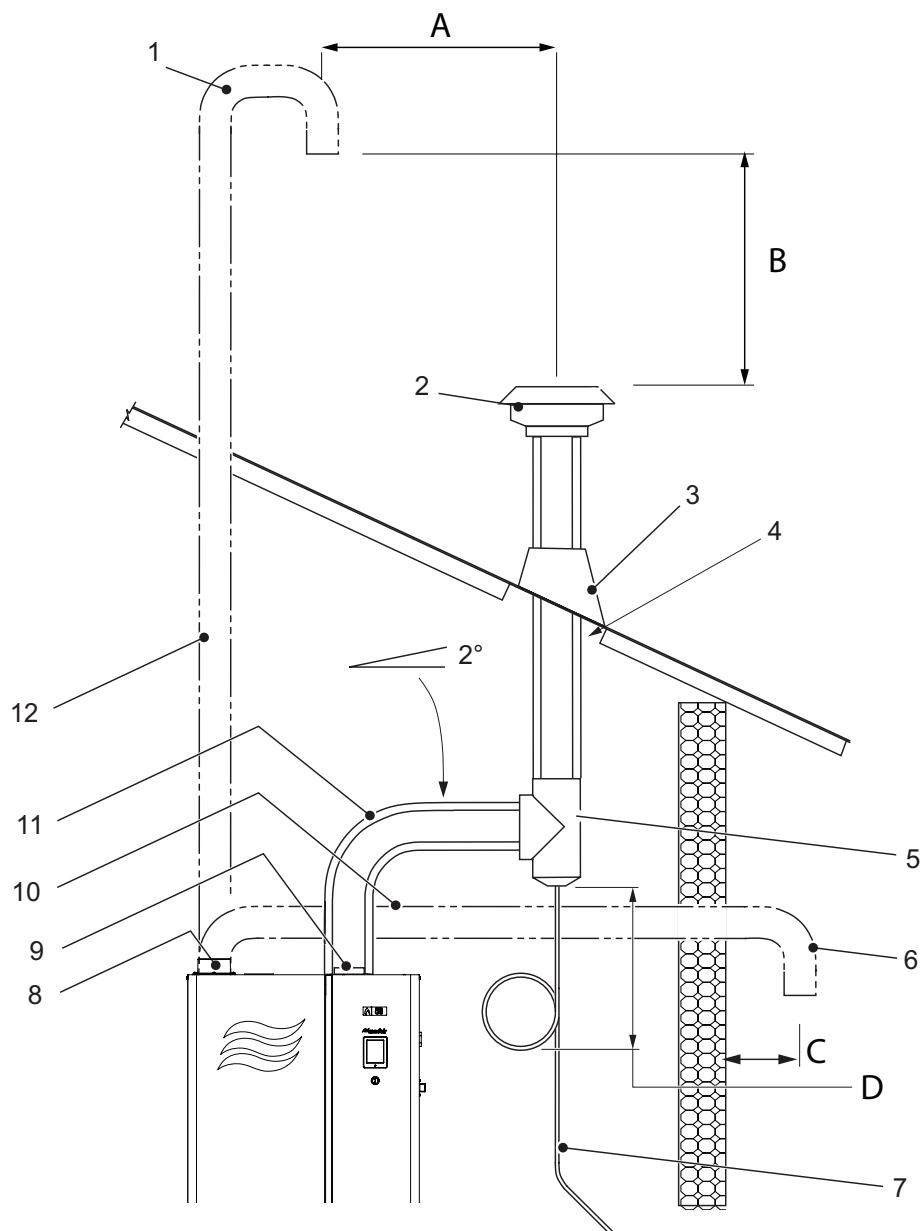


Figure 19: Vertical Venting (with Optional Sealed Combustion Hookup) – Category IV

- 1 Terminal, air intake – elbow pointed down (for optional sealed combustion vertical hookup)
- 2 Cap, vent, exhaust – UL/CSA-listed
- 3 Flashing
- 4 Air gap – must be maintained to local codes
- 5 "Tee", condensate
- 6 Terminal, air intake – 90° elbow pointed down, for optional sealed combustion hookup outside
- 7 Drain, condensate (with trap) – minimum 12 in (300 mm) trap height, and connected to floor drain or condensate pump
- 8 Inlet, air intake
- 9 Outlet, exhaust
- 10 Vent, air intake – for optional sealed combustion horizontal hookup
- 11 Vent, exhaust, type BH – refer to [Table 17 on page 41](#) for vent details. All joints air and water-tight. Short horizontal run with slope as shown (recommended, but not required). All horizontal-to-vertical transitions must include a full condensate "Tee" with condensate port and trap.
- 12 Vent, air intake – for optional sealed combustion vertical hookup
- A Horizontal distance between exhaust and air intake: 120 in (3000 mm) if exhaust is below air inlet; 48 in (1200 mm) if above inlet
- B Vertical distance between exhaust and air intake: 48 in (1200 mm) if exhaust is below air inlet; 36 in (900 mm) if above inlet
- C Air intake distance from wall: 12 in (300 mm) minimum
- D Condensate trap distance below exhaust: 24 in (610 mm) minimum

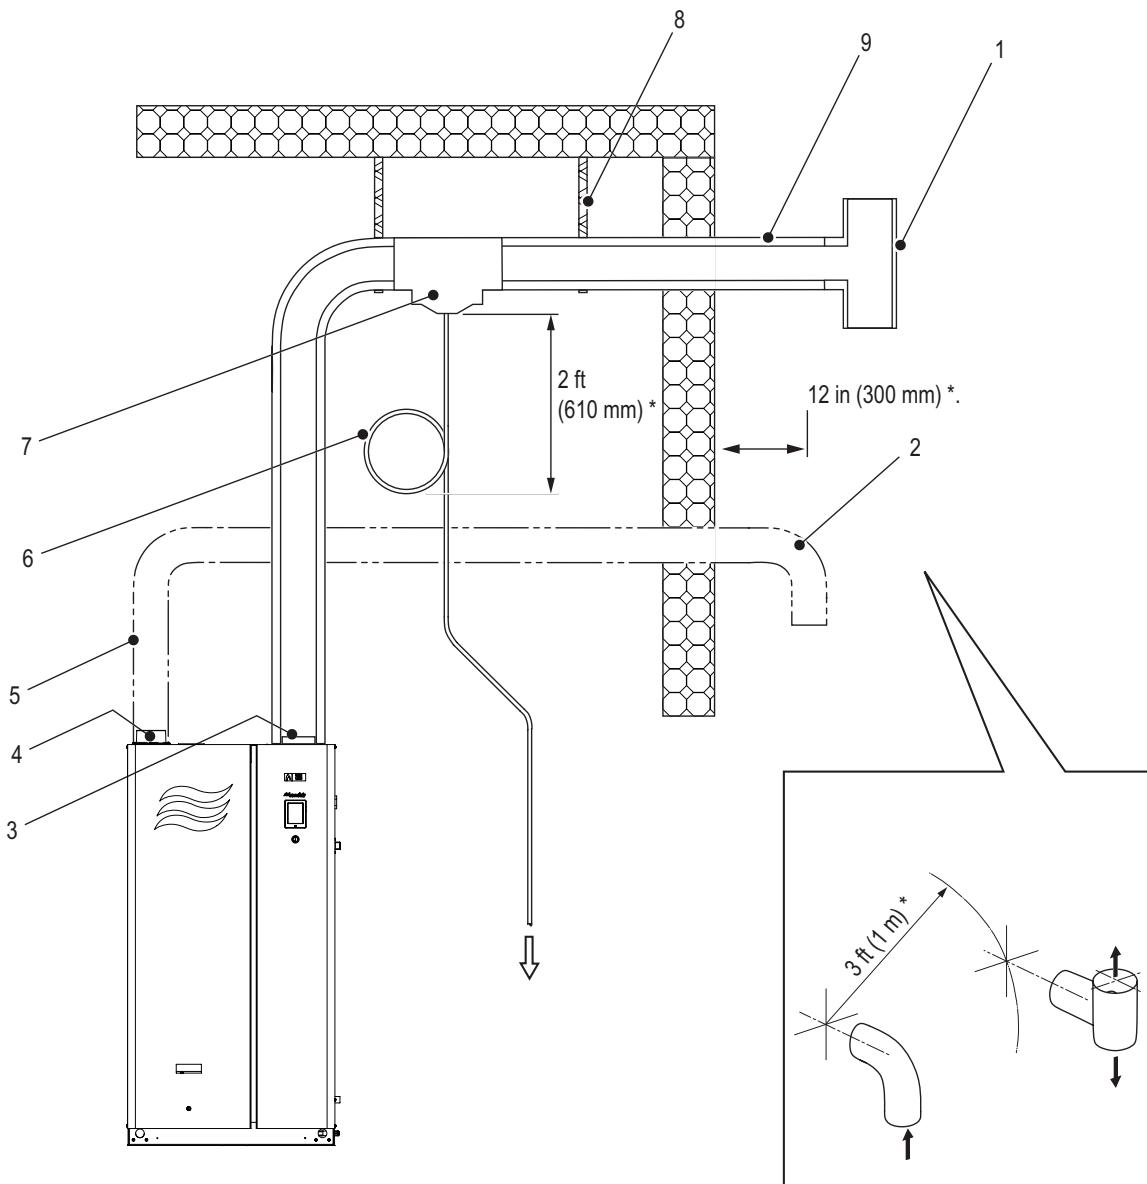


Figure 20: Horizontal Venting (with Optional Sealed Combustion Hookup) – Category IV

- 1 Terminal, exhaust ("Tee")
- 2 Terminal, air intake (90° elbow) – pointed down, for optional sealed combustion hookup
- 3 Outlet, exhaust outlet
- 4 Inlet, air intake
- 5 Vent, air intake – for optional sealed combustion horizontal hookup
- 6 Drain, condensate (with trap) – minimum 12 in (300 mm) trap height, and connected to floor drain or condensate pump
- 7 "Tee", condensate
- 8 Hanger
- 9 Vent, exhaust, type BH – refer to [Table 17 on page 41](#) for vent details. All joints air and water-tight. Full condensate "Tee" with condensate port and trap.

5.8.2 Exhaust Vent Installation for CS/NX/MT Model

All vent installations must be in accordance with national and the local regulations.

The exhaust outlet on the unit (CS/NXunits) has a female connection (metric size). Each unit is supplied with a metric-to-imperial adaptor (with internal gaskets) to accomodate imperial vent sizes.

Ensure that the exhaust vent is supported by hangers or pipe straps so that there is no load on the humidifier.

5.8.2.1 Installation as a Category IV Appliance

The CS/NX/MT must be installed as a Category IV fan-assisted gas appliance. In addition to the specific requirements described in this section, refer to ["General Requirements" on page 40](#).

To connect the exhaust vent, first insert the adaptor into the exhaust outlet and secure it to the top panel with four sheetmetal screws (supplied) – refer to [Figure 21](#). Then slide the exhaust vent into the adaptor until it bottoms out, and secure it with the clamp built into the adaptor. A sealant is not required.

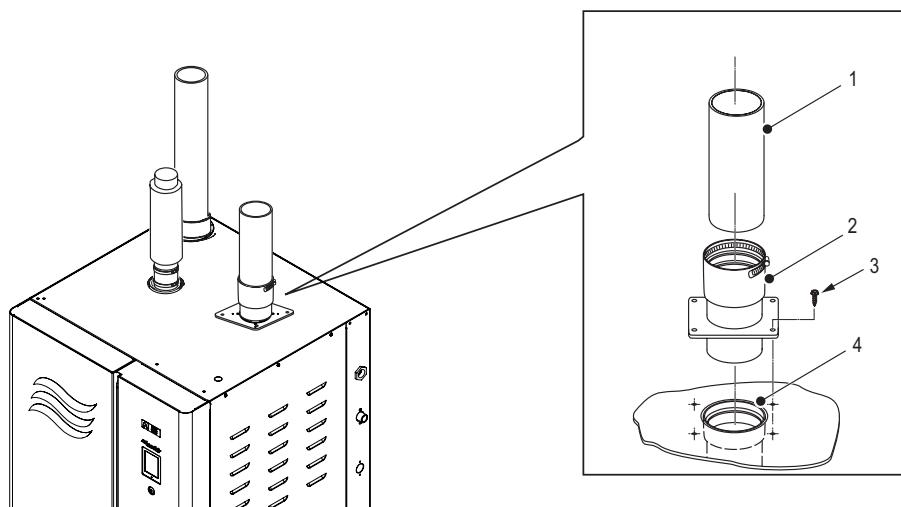


Figure 21: Exhaust Vent Connection – CS/NX/MT Model (Category IV Appliance)

- | | | | |
|---|---|---|----------------------------------|
| 1 | Vent, exhaust – CPVC or type BH (CPVC only for Condair GS CS and NX models. MT must use BH) | 3 | Screw, sheetmetal (x4, supplied) |
| 2 | Adaptor, exhaust (metric-to-imperial) – plastic (supplied with CS/NX models only) | 4 | Outlet, humidifier exhaust |

5.8.2.2 Installation Requirements for Category IV Appliances

The following requirements must be satisfied when the CS/NX/MT model humidifier is installed as a Category IV appliance:

- **Category IV** appliances can be vented vertically or horizontally, and can terminate on a rooftop or sidewall provided they meet the requirements of the National Fuel Gas Code (ANSI Z223.1), or CAN/CGA B149 Installation Codes. Refer to [Figure 20 on page 44](#) and [Figure 21 on page 45](#). Adhere to vent manufacturer's instructions.
- Refer to [Table 17 on page 41](#) for vent type and diameter of the exhaust vent for this type of installation. The vent diameter must remain uniform over the entire run.
- **Category IV:** The MT model humidifier can only be installed with type BH vents. The CS/NX model humidifier can be installed with type BH or plastic vents. Plastic pipe (CPVC certified to ULC-S636) is preferred. Type BH vent, if used, must be UL or UL/CSA-listed. **Note:** The GS 50-CS/NX must only use CPVC plastic pipe. The recommended manufacturer for CPVC plastic pipe is IPEX Inc.

- The following is a list of recommended stainless steel type BH vent manufacturers:
 - a. Flex-L International Inc.
 - c. Heat-Fab Inc.
 - b. FasNSeal
 - d. Z-Flex
- The exhaust vent must not connect to a common vent that is shared with any other natural gas appliance or power-assist appliance.
- The exhaust vent must not share a chimney flue servicing an appliance designed to burn solid fuel.
- All joints must be sealed using a sealant recommended by the vent manufacturer.
- The maximum operating flue temperature is:

Category IV: 160 °F (71 °C). Normal operating range is 120-140 °F (49-60 °C).
- The exhaust vent must have a minimum equivalent length of 10 ft (3 m), and must not exceed an equivalent length of 100 ft (30 m), except for the Condair GS 50 using propane gas which is limited to 50 ft (15 m). The pipe diameter must remain uniform over the entire run. The vent run should be as direct as possible with no more than six elbows in the system. Each 90° elbow is equivalent to 10 ft (3 m), and each 45° elbow is equivalent to 5 ft (1.5 m) of straight pipe.
- Exhaust vents used in sealed combustion applications must not exceed an equivalent length of 100 ft (30 m), except for the Condair GS 50 using propane gas which is limited to 50 ft (15 m).
- Category IV: During normal operation, a Category IV appliance will create exhaust condensate. Install condensate drain lines according to vent manufacturer's instructions every 15 ft (4.5 m) on all horizontal runs, and at every horizontal-to-vertical transition. Install a full "Tee" with condensate port and trap at all horizontal-to-vertical transitions. The condensate trap must be minimum 12 in (300 mm) in diameter. Refer to [Figure 20 on page 44](#) and [Figure 21 on page 45](#).
- **Category IV:** Install condensate neutralizer on CS/NX models, if required by local code.

5.8.3 Exhaust Vent Checklist

Check the following to ensure that the exhaust vent for the humidifier has been installed correctly:

- Exhaust vent installed to meet all national and local codes, vent manufacturer and Condair requirements?
- Proper clearances maintained between exhaust vent and combustible materials?
- Exhaust vent diameter as listed in [Table 17 on page 41](#), and uniform over the entire run?
- Exhaust vent length does not exceed an equivalent length of 100 ft (30 m)?
If unit is a Condair GS 50 using propane gas, is it limited to 50 ft (15 m)? Maximum six elbows in the exhaust vent?
- Exhaust vent secured properly with hangers or pipe straps?

5.9 Gas Connection

Gas piping must meet the requirements of the National Fuel Gas Code (ANSI Z223.1) in the USA, or CAN/CGA B149 Installation Codes in Canada, or applicable gas supply pressure requirements of the local building codes.

Refer to ["Site Requirements" on page 18](#) for the gas supply requirements. For gas connection sizes refer to [Table 8 on page 20](#). In addition, refer to ["Gas Connection Requirements" on page 47](#).

IMPORTANT! Tampering with the gas valve without the express consent of Condair will void the warranty.

5.9.1 Gas Connection, Compact and Full-Size Unit

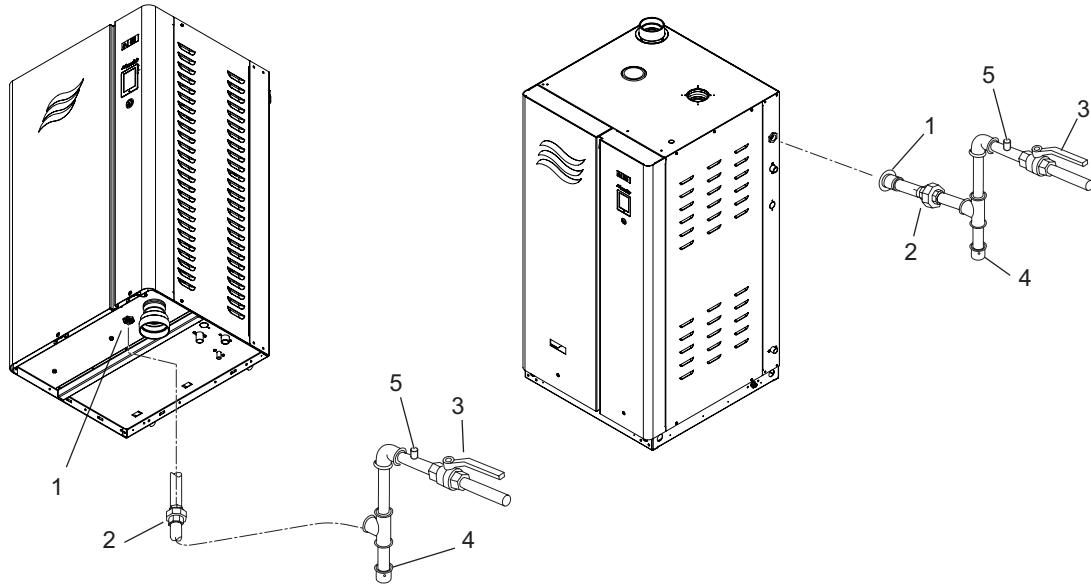


Figure 22: Gas Connection

1	Gas inlet NPT female (full-size unit)	3	Valve, manual gas shutoff (not supplied)	4	Trap, sediment (not supplied)
2	Fitting, union (not supplied)			5	Test port (not supplied)

Note: For Condair GS 450 and Condair GS 600 only, the gas line will require a 1-1/4 to 1 in NPT adaptor (not supplied) to connect to the inlet gas connection on the unit.

Note: Where measuring of the gas firing rate of the humidifier is necessary, installing a gas meter (not supplied) at the gas supply line is recommended.

Gas Connection Requirements

In addition to the requirements of the applicable national and local codes for gas connections, the following requirements must also be satisfied:

- A certified manual gas shutoff valve must be installed immediately upstream from the humidifier. Refer to [Figure 22](#). Thermally actuated gas shut-off device may also be installed upstream from the humidifier. Install the device following all local codes and regulations.
- For gas inlet size and gas line size refer to ["Gas Line Size" on page 20](#).
- If black pipe is used, a sediment trap must also be installed immediately upstream from the humidifier.

IMPORTANT! Route the gas line so that it does not obstruct access to any of the services to the humidifier. On the compact unit, make sure that the maintenance access for the drain pump is not obstructed.

- DO NOT use teflon tape on gas line pipe threads. A flexible sealant suitable for use with natural gas and propane gas is required.
- All gas piping must be adequately supported to prevent any strain on the humidifier gas connection.
- Upon completion of the gas installation, perform the ["Gas Leakage Test" on page 48](#).

5.9.2 Gas Leakage Test



DANGER!
Risk of explosion and fire!

Prevention: NEVER use an open flame to check for gas leaks. Risk of injury, death or property damage. Use a commercial soap solution or a gas sniffer to check for leaks.



CAUTION!
Risk of damage to the gas valve!

Prevention: Before performing the leakage test described below, close the manual gas shutoff valve at the humidifier to isolate the gas valve from system pressure. Failure to do so may damage the gas valve, and will void warranty.

1. Close the manual gas shutoff valve at the humidifier.
2. Pressurize the gas supply line to a maximum of 14 in H₂O (3.5 kPa), and test all gas connections external to the humidifier for leaks using a commercial soap solution or a gas sniffer. Seal all leaks before operating the humidifier.
3. After completing the leakage test, de-pressurize the gas supply line BEFORE opening the manual gas shutoff valve.

5.9.3 Gas Connection Checklist

Check the following to ensure that the gas connection for the humidifier has been installed correctly:

- Certified manual gas shutoff valve installed immediately upstream from the humidifier?
- Thermally actuated gas shut-off device may be installed on the gas line, before the humidifier. Installed the device following all local codes and regulations?
- Sediment trap installed (if using black pipe)?
- Gas pipe routing allow clear access to other service connections at humidifier?
- Gas piping adequately supported?
- Gas leakage test completed, and all leaks fixed?
- De-pressurize gas supply line after leak test?

5.10 Humidity Control Systems

5.10.1 Control Device Locations

The following schematic describes a potential system setup with respect to control devices. Refer to [Figure 23](#).

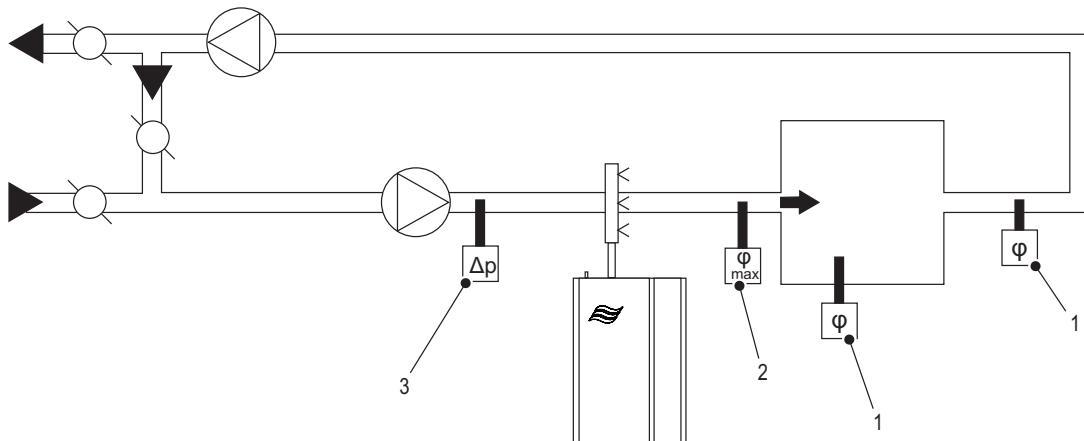


Figure 23: System Setup Schematic

1 Humidistat or humidity sensor 2 High limit humidistat or humidity sensor 3 Switch, air proving

Notes:

- Locate the air proving switch in the same duct as the humidifier's distributor so that it can sense air flow (or lack thereof).
- Locate the high limit humidistat downstream of the humidifier's distributor so that it can sense a duct that is over-humidified. Recommended setting is 85% RH. Locate it downstream of the distributor – at least 5x the absorption distance away. If the absorption distance is not known, locate it at least 10 ft (3 m) downstream from the distributor. Can be a humidistat (modulating or On/Off), or a humidity sensor.
- Humidity sensors and humidistats can be modulating or On/Off. Preferred location is in the return duct, as the supply air is well mixed with the room air at this location. Avoid placing near discharge diffuser, near doorways, in sunlight, or in airflow “dead-zones”.

5.10.2 Permissible Control Signal Inputs

[Table 18](#) shows the different permissible control signal inputs the Condair GS humidifier can handle.

Table 18: Permissible Control Signal Inputs

Humidity Control with External Controller Control Signals	Humidity Control with Internal PI Controller Humidity Sensor Signals	Digital Inputs (via Modbus, BACnet IP/MSTP slave)
0-5 VDC (potentiometer 135-10k Ω) 1-5 VDC 0-10 VDC 2-10 VDC 0-20 VDC 0-16 VDC 3.2-16 VDC 0-20 mA 4-20 mA	0-5 VDC (potentiometer 135-10k Ω) 1-5 VDC 0-10 VDC 2-10 VDC 0-20 VDC 0-16 VDC 3.2-16 VDC 0-20 mA 4-20 mA	BACnet IP BACnet MSTP Lonworks (Option) BACnet MSTP BTL Certified (Option) BACnet IP BTL Certified (Option)
Humidistat (24 V On/Off)		

5.11 Electrical Connections

Refer to ["Site Requirements" on page 18](#) for the electrical requirements.

Install the electrical connections according to the wiring diagram(s) ([Figure 24 on page 51](#), and [Figure 25 on page 52](#), as applicable) and the instructions for ["External Connections" on page 53](#).

For connecting multiple Condair GS humidifiers, refer to ["Connecting Multiple Units Using Linkup" on page 59](#).

5.11.1 General

Safety

The electrical installation work requires removal of the access panels in the humidifier. Observe the following safety precautions:



DANGER!

Risk of electric shock!

The Condair GS humidifier is mains powered. Live parts may be exposed when the access panels are removed. Touching live parts may cause severe injury or even death.

Prevention: The Condair GS humidifier must be connected to the mains only after all installation work has been completed, checked for correct workmanship, and the access panels are installed and properly locked.



CAUTION!

Electrostatic discharge (ESD)!

The electronic components inside the humidifier are sensitive to electrostatic discharge (ESD).

Prevention: Take appropriate measures to protect the electronic components inside the unit against damage caused by electrostatic discharge (ESD). Refer to ANSI/ESD-S20.20.

- All electrical installation work must be performed only by a licensed electrician authorized by the customer. It is the customer's responsibility to verify qualifications of the personnel.
- The electrical installation must be performed according to the wiring diagrams in this manual, the instructions in this section, as well as applicable national and local codes.
- Make sure that the main power cable is properly grounded through the ground lug inside the control cabinet. When installed, the appliance must be electrically grounded in accordance with local codes or, in the absence of local codes, with the National Electrical Code (ANSI/NFPA70) in the USA, and/or CSA C22.1 Electrical Code in Canada.
- Field wiring from the humidistat to the humidifier and between devices must be shielded minimum 18 AWG, and shall conform with temperature rise limitation of 63 °F (35 °C) for Type-T wire.
- All cables must lead into the unit, via appropriate strain relief connectors, and be secured with clamp straps.
- Make sure the cables are secured, and do not rub on any components or become a tripping hazard.
- Adhere to national and local codes for maximum cable length and required wire sizes for cables.

5.11.2 Wiring Diagrams

5.11.2.1 Condair GS - All Units

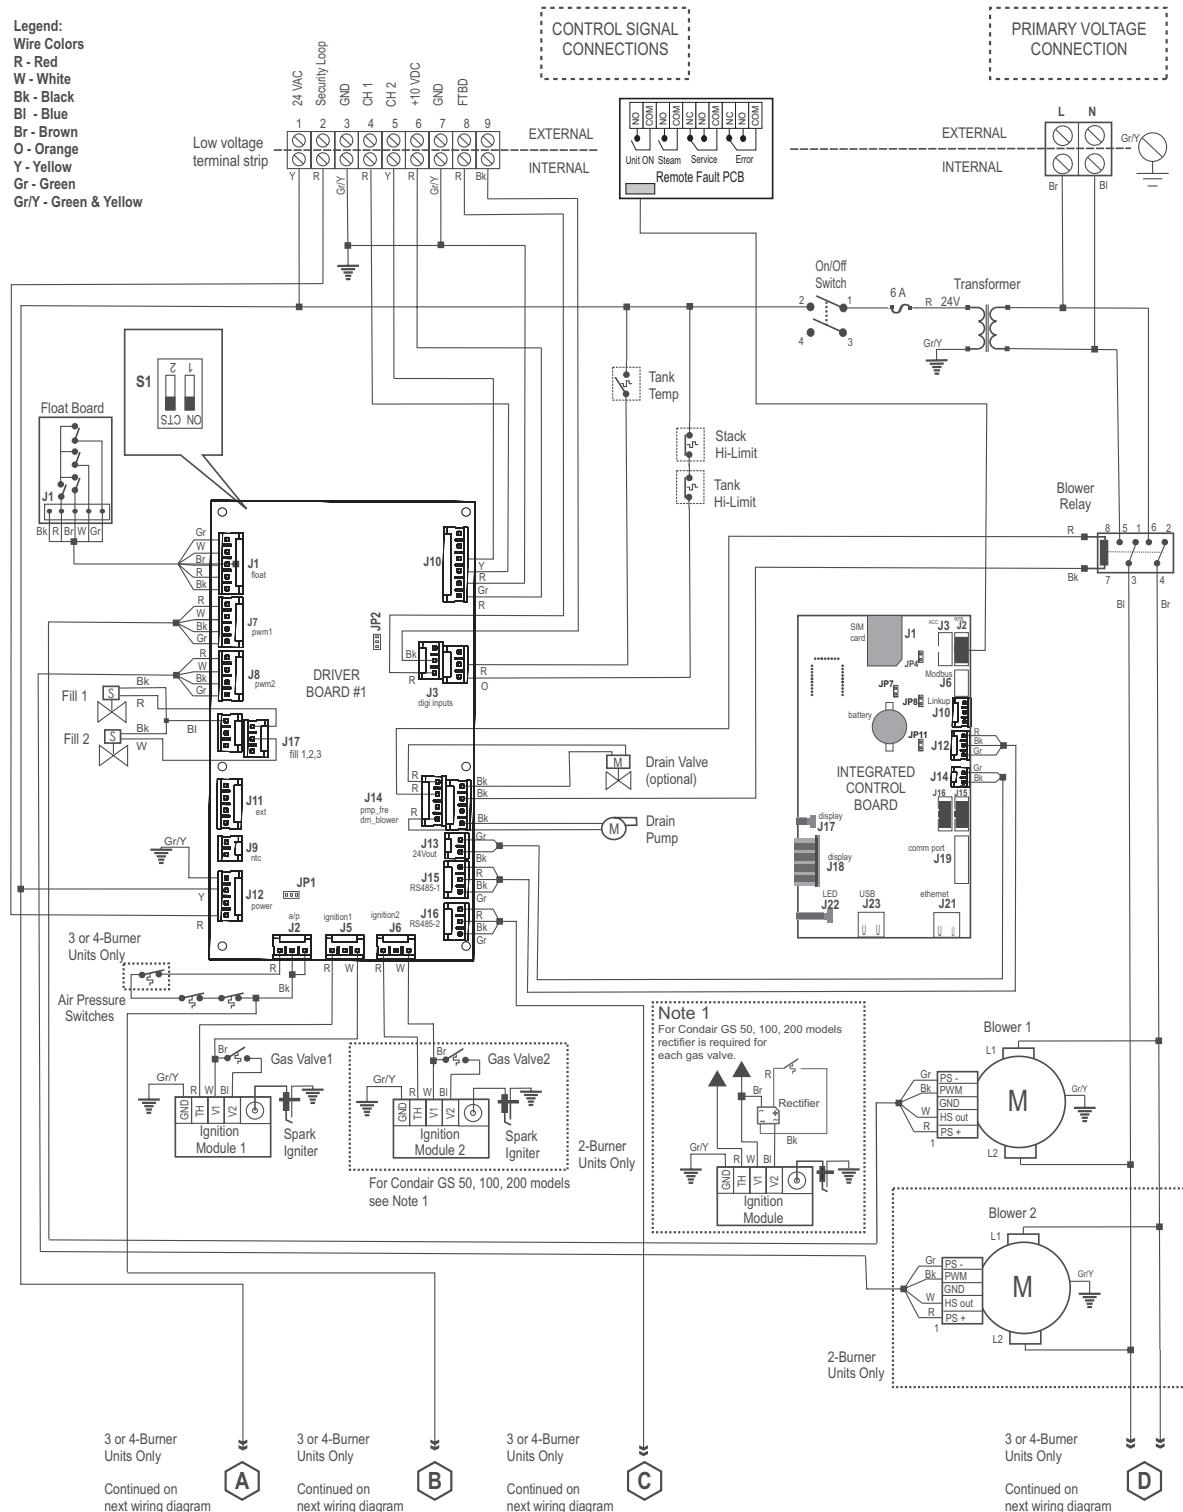


Figure 24: Wiring Diagram - Condair GS 50/100/150/200/300/450/600

JP4 Jumper – for activating the termination resistor for Modbus or BACnet MSTP network.

J6 Connector Modbus (RS485 interface)

• IP7 : jumper – for activating Modbus or BACnet MSTP communication via connector J6

JP7 Jumper – for activating Mod
JP8 Termination Linkup system

JP8 Termination, Linkup

5.11.2.2 Condair GS - 450/600

Figure 25 shows the supplementary wiring diagram for the Condair GS 450 and Condair GS 600. The connections are carried over from Figure 24 on page 51.

Legend:
 Wire Colors
 R - Red
 W - White
 Bk - Black
 Bl - Blue
 Br - Brown
 O - Orange
 Y - Yellow
 Gr - Green
 Gr/Y - Green & Yellow

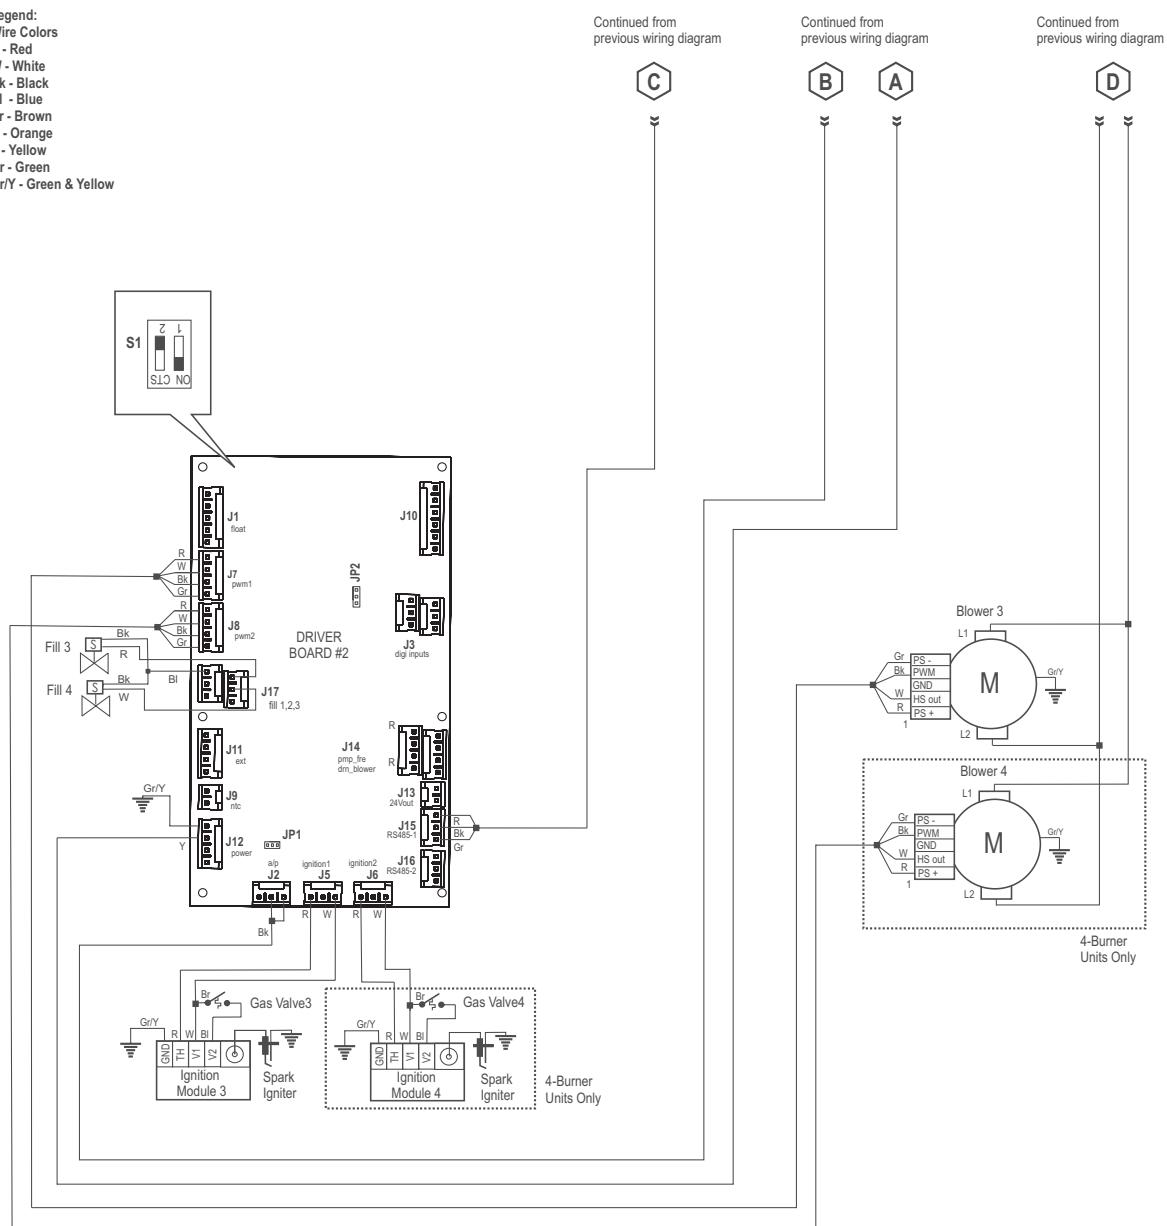


Figure 25: Wiring Diagram - Condair GS 450/600

5.11.3 External Connections

This section describes the different external control signal and power connections to the Condair GS humidifier.

5.11.3.1 External Security Loop

The external security loop consists of dry contacts of the external monitoring devices (for example, ventilation interlock, high limit humidistat, air proving switch, etc.). Connect the external safety devices in series to pins "1" and "2" in the low voltage terminal strip. Refer to [Figure 24 on page 51](#) and [Figure 26](#).

IMPORTANT! Keep length of the 24V security loop (safety chain) as short as possible. The length of the security loop depends on the cross section of the wires used.

IMPORTANT! A high limit humidistat is highly recommended to prevent over-humidification and potential damage to property.

IMPORTANT! Install a jumper between pins "1" and "2" in the low voltage terminal strip if no external On/Off devices are connected to the security loop.

The connecting cables must lead into the control cabinet through a cable gland or grommet.



CAUTION! Risk of damage to internal components!

Prevention: DO NOT apply voltage to low voltage terminal strip pins "1" and "2" through the contacts of the external On/Off devices.

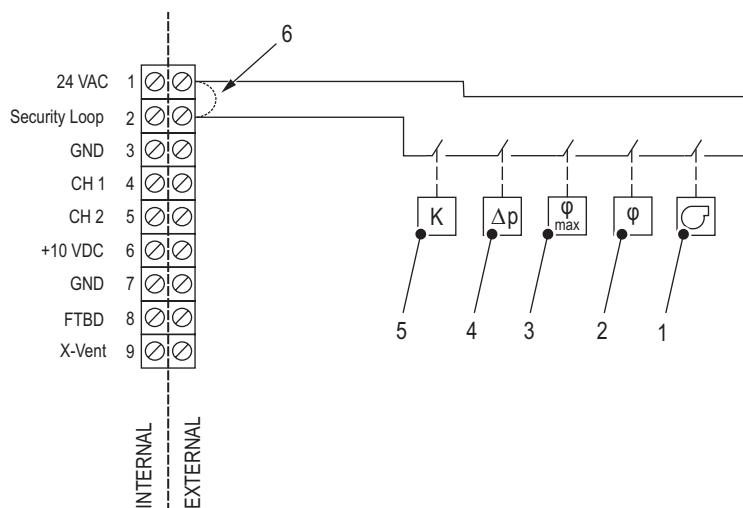


Figure 26: External Security Loop Connections

- 1 Blower pack
- 2 Humidistat, On/Off
- 3 Humidistat, high limit
- 4 Switch, air proving
- 5 Interlock, ventilation
- 6 Jumper (installed if no devices connected to security loop)

5.11.3.2 Modulating Demand or Humidity/Limiter Signal

Connect an external humidity sensor input or direct demand modulating input to pins "3" and "4" in the low voltage terminal strip. Refer to [Figure 24 on page 51](#) and [Figure 27](#). The permissible control signal input values are shown in [Table 18 on page 49](#).

Do not connect multiple modulating signals to the same modulating input on the humidifier. If necessary, connect the second modulating signal to pin "5" and "3", using pin "3" as common. Make sure that "Control Channels" is set to "Dual" in the control software to utilize the second modulating signal – refer to the Operation and Maintenance Manual.

Alternately, transducer signals or demand signals can be written to the humidifier via a valid digital communication protocol.

The signal cable must lead into the control cabinet through an appropriate strain relief connector. If a shielded signal cable is used, connect the shielding to pin "3".



CAUTION!

If the shielding of the signal is already connected to a potential or a grounded conductor, do not connect it to pin "3".

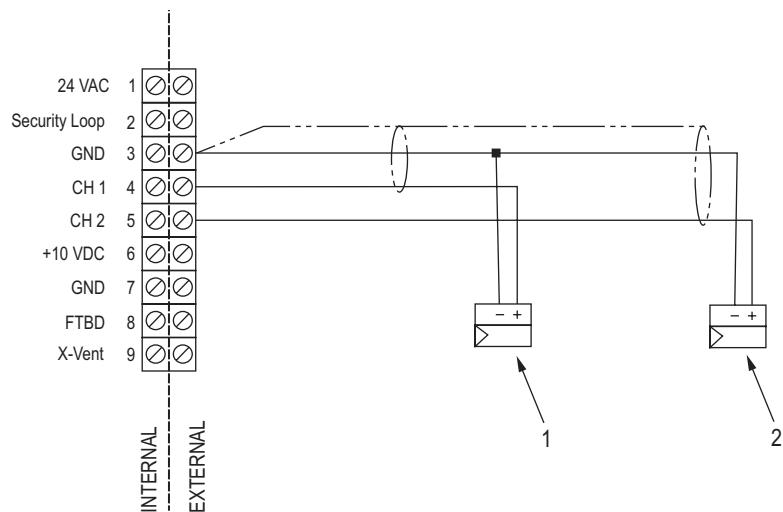


Figure 27: Modulating Demand or Humidity Signal Connections

- 1 Modulating demand or humidity sensor signal
- 2 Modulating high limit demand or humidity sensor signal (additional, for Dual channels)

5.11.3.3 On/Off Humidistat Signal

If an On/Off humidistat is used, connect the signal cable to terminal pins "4" and "6" in the low voltage terminal strip. Refer to [Figure 28](#). Set Control Mode must be set to "On/Off" in the control software – refer to the Operation and Maintenance Manual.

IMPORTANT! When connecting a 24 VDC On/Off humidistat, jumper JP2 on the driver board must be set to 24 V (so that pin "6" will output 24 VDC).

Note: By default the jumper JP2 is set to 10 VDC, so that the output can also be used for test purposes.

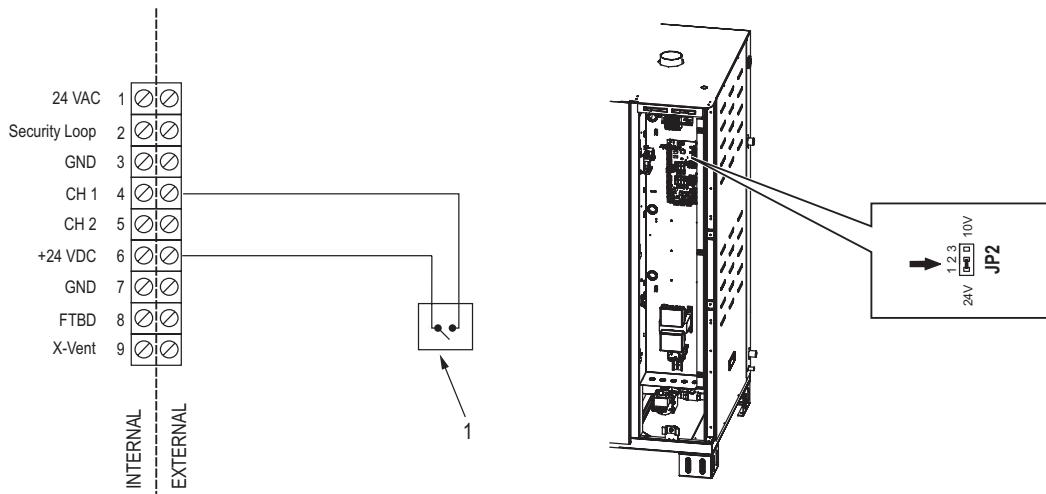


Figure 28: 24 V On/Off Humidistat Connection

1 Humidistat, 24 VDC On/Off

5.11.3.4 Full Tank Blowdown Signal Connection

If an external full tank blowdown signal is used, connect the 24 VAC input signal to pins "1" and "8" in the low voltage terminal strip. Refer to [Figure 29](#).

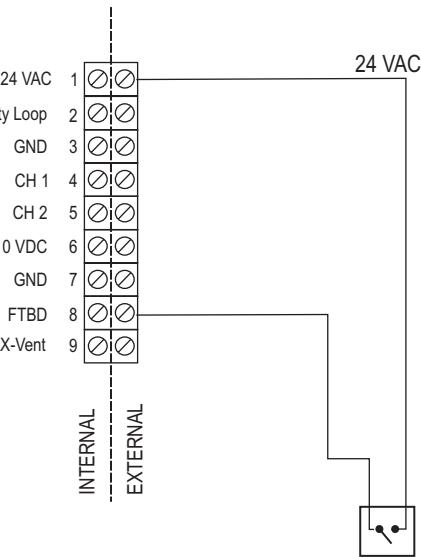


Figure 29: Full Tank Blowdown Signal Connection

5.11.3.5 Remote Fault PCB Connections

The remote fault PCB (printed circuit board) in the humidifier has the following four dry relay contacts for remote display of humidifier status and fault conditions. Refer to [Figure 30](#) for the relevant terminal contacts.

- Error – this relay can be wired to open (NC) or close (NO) when a fault is detected by the humidifier controls.
- Service – this relay is activated when the set maintenance interval elapses. It can be wired to open (NC) or close (NO) when a warning appears on the touchscreen panel of the humidifier and the status LED turns yellow in color.

Note: This relay can be configured in the control software to indicate status updates or system warnings – refer to the Remote Fault Board tab in the Operation and Maintenance Manual.

- Steam – this normally open (NO) relay closes when the unit is producing steam.
- Unit on – this normally open (NO) relay closes when the humidifier has power, and the On/Off switch is in the On position.

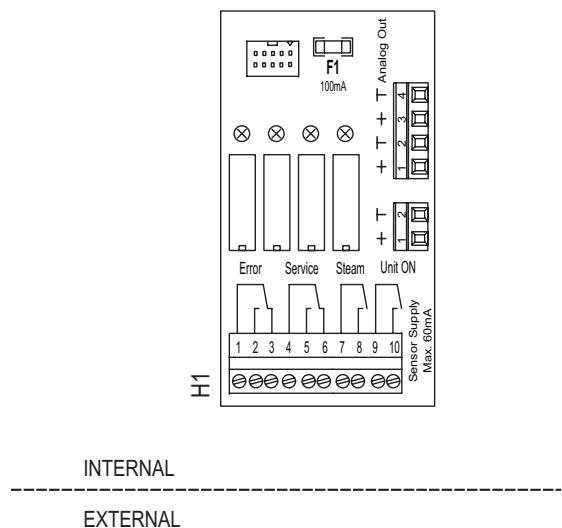


Figure 30: Remote Fault PCB Connections

The remote relay PCB connects to the connector J2 on the Condair GS control board.

5.11.3.6 Single-Phase Power Supply Connection

Connect the single-phase power supply to the Condair GS humidifier as shown in [Figure 31](#). Refer to the specification label (["Model Specifications" on page 12](#)) for power requirement and sizing of fused disconnect switch (slow acting). **The installation of an external fused disconnect switch with 10A, slow acting fuses in the main supply line are mandatory.**

IMPORTANT! Make sure that the main power cable is properly grounded through the ground lug inside the control cabinet.

All wiring must be in accordance with national and local electrical codes.

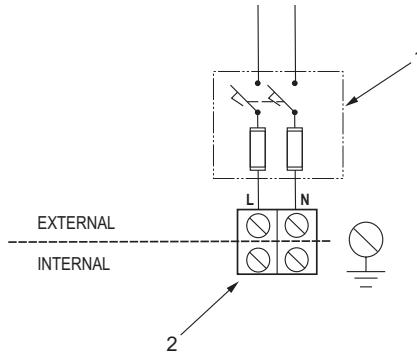


Figure 31: Single-Phase Power Supply Connections

- 1 External fused disconnect switch
- 2 Terminal block, power supply

5.11.3.7 Modbus Connection

The Condair GS humidifier comes standard with a Modbus communications interface, which can be used to remotely control its output or monitor its operation.

Refer to [Figure 32](#) and connect the Modbus communication cable to the Condair GS humidifier as follows:

1. Connect a Modbus cable to the connector J6 on the Condair GS control board. Refer to [Table 19](#) for Modbus cable requirements, and [Table 20](#) for communication parameters. Contact your Condair representative if assistance is needed to change the default communication parameters.

Note: The jumper JP7 on the control board must be installed to activate Modbus or BACnet MSTP communication via RS485 interface (J6). If the jumper is not installed, no communication will take place through J6.

2. Install the jumper JP4 on the control board if the humidifier is the first or last unit in the network.

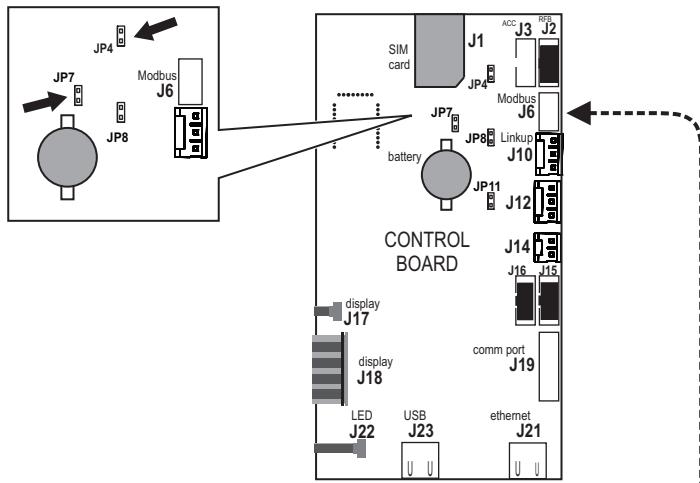


Figure 32: Modbus Connection on Condair GS Humidifier

JP4 Jumper – for activating the termination resistor for Modbus or BACnet MSTP network

J6 Connector, Modbus (RS485 interface)

JP7 Jumper – for activating Modbus or BACnet MSTP communication via RS485 interface (J6)

Table 19: ModBus Cable Requirements

BMS Protocol	Signal Type	Recommended Cable	Maximum Distance from humidifier to BMS ft (m)
Modbus	EIA-485, 2-wire	18-24 AWG shielded, twisted pair, 120Ω *	2200 (670)

* Connect humidifiers in a daisy chain to the Modbus RTU. Ground shield at on end only – either at the BMS or the humidifier.

Table 20: Modbus Communication Parameters

Parameter	Default	Adjustable Range
Signal type	EIA-485	–
Transmission mode	RTU	–
Baud rate	9600	110, 300, 600, 1200, 2400, 4800, 9600, 19200, 38400, 57600, 76800 or 115200
Data bits	8	–
Stop bits	1	–
Parity	Even	Odd, Even, None
Address	10	1-247
Time out	300 s	1-300 s

5.11.4 Connecting Multiple Units Using Linkup

The integrated control board in the humidifier allows up to four integrated controllers to connect in a "main-extension" configuration using Condair's Linkup system. All the humidifiers within this setup must share the same environment, and be controlled by one set of control signals connected to the main unit.

Refer to [Figure 33](#) and connect multiple unit using Linkup as follows:

1. Connect all control signals for the entire Linkup configuration to the low voltage terminal strip in the main unit.
2. Install a jumper wire between the pins "1" and "2" in the low voltage terminal strip on all extension units.
3. Connect a multi-strand twisted pair shielded cable (18-24 AWG, 120 Ω) between the J10 connectors on the control board of each humidifier in the Linkup system. **Note:** Maximum recommended distance between units is 100 ft (30 m).

IMPORTANT! Do not reverse polarity.

4. Install the termination jumper JP8 in the control board of the last extension unit in the Linkup system.
5. Finally, refer to the Operation and Maintenance Manual to set up the multi-unit configuration in the control software.

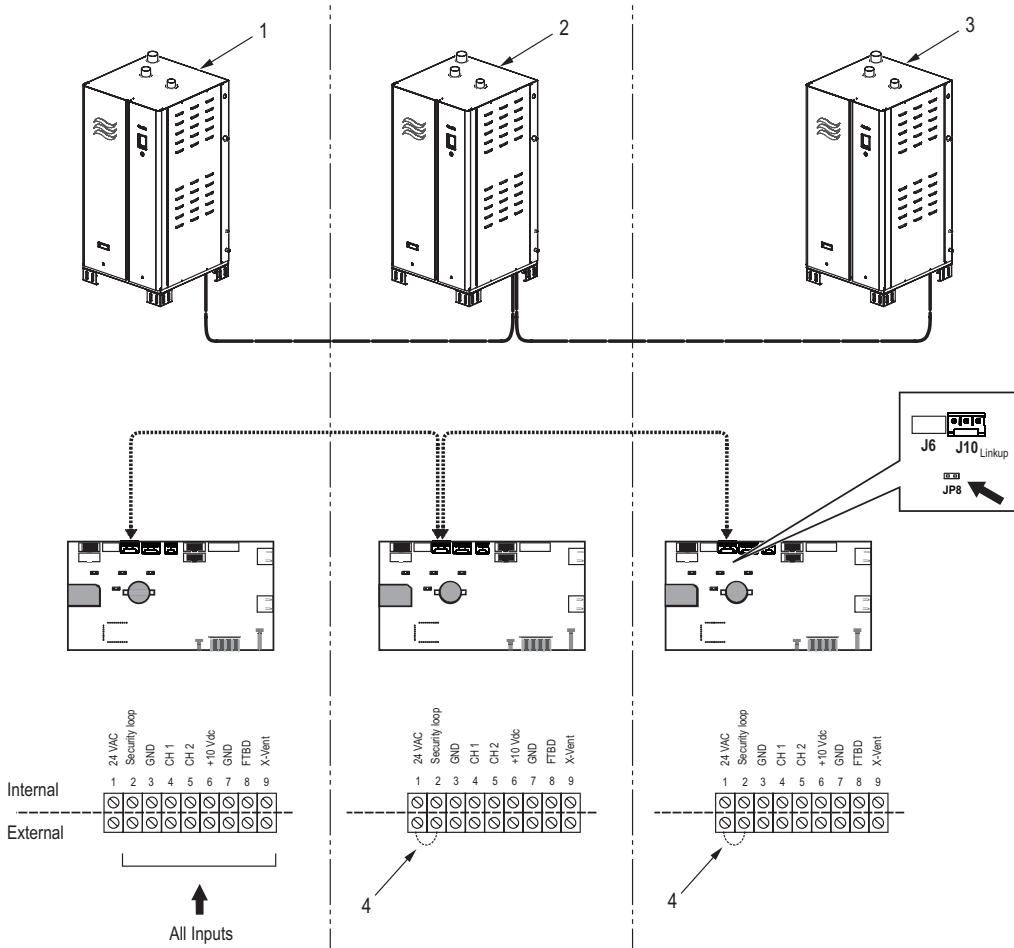


Figure 33: Multi-Unit Linkup Connections

- 1 Main unit (all control signals connected to main unit)
- 2 Extension unit #1 (no control signals to unit)
- 3 Extension unit #X (no control signals to unit)
- 4 Jumper (on all extension units)

5.11.5 Electrical Connections Checklist

- Check the following to ensure that the electrical connections for the humidifier have been installed correctly:
- Power supply meet the rated current draw limits shown on the specification label (["Model Specifications" on page 12](#))?
- Power supply have an external dedicated fused disconnect switch?
- All wiring done according to the wiring diagram and instructions in this manual?
- Main power cable proper grounding through the ground lug inside the electric cabinet?
- All cables fastened securely?
- All cables free of tension and pass through cable glands or grommets?
- Electrical installation meet the applicable national and local codes?
- All access panels closed and fastened securely?

6 Commissioning

6.1 Commissioning Checklist

The humidifier must always be commissioned for the first time by a service technician from your local Condair representative, by a Condair employee, or by personnel who are well trained and authorized by the customer. It is the customer's responsibility to verify the qualifications of personnel.

The intent of the commissioning checklist is to verify that the humidification system has been installed according to the installation manual.

Commissioning of the humidifier consists of two steps – an inspection of the site services and the installation prior to start-up, and performance tests of the unit. Complete the "[Pre-Start-Up Checklist](#)" below and "[Performance Checklist](#)" on page 67. Enter all notes and exceptions in the space provided on [Page 68](#). Retain this copy in the installation manual, and submit a copy of the completed forms to your local Condair representative.

6.1.1 Pre-Start-Up Checklist

Inspect the site services and the installation, and fill out the form below. Note: When filling out the form leave the checkbox un-checked if the item does not apply, or if the requirement is not satisfied.

Serial Number:			Tag:		
Model:		Capacity:		Voltage and Phase:	
Customer/Job:			Representative:		
Customer Address:					

Site Ambient Conditions

Ambient temperature: (Permissible range – 41-104 °F (5-40 °C))	
Ambient humidity level: (Permissible range – 5-95% RH, non-condensing)	

Site Water Supply

Well water
City water
Softened water
Reverse osmosis (RO)
De-ionized water (DI)

Refer to [Table 14 on page 34](#) for water quality requirements. **Note:** Run the water for approximately five minutes before performing the tests:

Site Water Quality	Acceptable Range	Measurement *
Conductivity (µS/cm):	0-1500	
Hardness gpg (ppm):	0-20.42 (0-350)	
Silica (ppm):	0-14	
Chlorides (ppm):	0-40	
pH level:	pH 6.5 - 8.5 **	

* Test sample must be collected as close as possible to the fill valve in the humidifier, so that the sample reflects the characteristics of the supply water entering the unit.

** If pH is >7.5 and the content of Sodium and/or sulfates are also high, the risk of foaming is increased.

Site Water Supply, continued...

Water supply pressure meets requirement: (Permissible range – 30-80 psig (207-550 kPa) Select checkbox, or enter measurement, as appropriate).	
Water supply pipe sized correctly: (Minimum 1/2 in (13 mm) diameter required).	
Water supply temperature meets requirement: (Optimal range – 34-59 °F (1-15 °C); maximum 77 °F (25 °C)) Select checkbox, or enter measurement, as appropriate).	
Water supply piping material: (Materials certified for drinking water systems permitted; plastic or stainless steel only for DI water).	
Filter installed close to humidifier: (5 µm – optional, but recommended)	
Shutoff valve and union fitting installed:	
No pressure surges: (Surge protection device must be installed, if necessary).	
All debris flushed from supply line:	
No leakages in supply line:	
Note: For the Condair GS 450/600 units, check water supply to each dual fill valve.	

Drainage

Drain pipe (funnel to building drain) diameter meets requirement: (Minimum 1-1/2 in (38 mm) diameter required).	
Humidifier drain piping material meets requirement: (Must handle temperatures to 212 °F (100 °C)).	
Drain pipe sloped adequately: (Minimum downslope of 1 in/48 in (1.2°) to air gap funnel).	
Air gap funnel size meets requirement: (Minimum 2-1/2 in (64 mm) diameter required).	
Drain pipe does not touch sides or bottom of air gap funnel:	
Air gap funnel location does not permit any rising steam to enter control cabinet:	
Air gap funnel located within 3 ft (1 m) from the unit (or according to code):	
Drainage rate of building drain meets requirement: (Minimum 2.64 gal/min (10 l/min) for GS 50-300 unit, 5.28 gal/min (20 l/min) for GS 450/600).	
Building drain piping material meets requirement: (Only copper or stainless steel permitted; stainless steel only for DI water).	

Site Gas Connection

Gas type: (Natural gas or propane)	
Gas supply pressure: (Natural gas permissible range – 5-10 in H ₂ O (1.25-2.49 kPa) Propane permissible range – 9-14 in H ₂ O (2.24-23.49 kPa))	
Manual gas shutoff valve installed: Distance from humidifier: (Manual shutoff valve must be installed per local code).	
Union fitting installed in gas line:	
Gas supply pipe diameter and connection meet requirements: (Refer to Table 8 on page 20 for details).	
Gas supply piping material: (Stainless steel or black pipe permitted)	
Sediment trap installed: (Sediment trap required if black pipe is used for gas line).	
Performed leakage test on gas line (up to unit):	

Humidifier Mounting

Refer to [Table 9 on page 21](#) and [Table 10 on page 21](#) for required and suggested clearances respectively.

Non-combustible mounting surface? (Withstand temperatures 140-158 °F (60-70 °C))	
Unit level?	
Front clearance:	
Left side clearance:	
Right side clearance:	
Ground clearance:	
Overhead clearance:	

Steam Line(s)

Steam line diameter and equivalent length meet requirements: (Refer to Table 12 on page 27 for details).	
Steam line piping material meets requirement: (Copper (MED Type-L) or stainless steel (minimum DIN 1.4301) required).	
Type of insulation:	
Slope of steam line meets requirement: (Minimum constant upslope of 2 in/12 in (10°), or minimum constant downslope of 1/2 in/12 in (2°) required).	
Steam line rises straight up minimum 12 in (300 mm) before first bend:	
Steam line does not reduce in diameter or merge, except at steam distributor:	
No restrictions/kinks in steam line:	
Steam line fully supported, with no sags:	
All debris flushed from steam line:	
Backpressure meets requirement: (Maximum permissible static pressure and backpressure in steam line – 6 in H ₂ O (1.49 kPa) for compact units; or 10 in H ₂ O (2.49 kPa) for full-size units)	
Duct static pressure: (Enter static pressure (if available), and if positive or negative pressure).	

Steam Line Condensate Drains

Note: Make sure all condensate drains meet these requirements.

Slope of all condensate lines meets requirement: (Minimum constant downslope of 1 in/48 in (1.2°) required).	
Condensate lines connect to full-size Tee connectors:	
Diameter of condensate traps meets requirement: (Minimum 12 in (300 mm) required).	
Condensate trap drop meets requirement: (Minimum 12 in (300 mm) below condensate Tee and steam distributor required).	
Condensate traps installed at all low points, and horizontal-to-vertical transitions in steam line:	
Condensate traps installed at regular intervals on long runs exceeding 15 ft (4.5 m):	
Condensate lines have individual traps before emptying into a common drain:	
No restrictions/kinks in condensate lines:	
All debris flushed from condensate lines:	
Condensate cooling installed, (if required by local code):	
All condensate traps primed:	

Electrical Power Connections

Power supply meets voltage and current requirements shown on specification label:	
Dedicated external fused disconnect switch installed to local code: (The maximum current to the unit must not exceed 15 A).	
Phase-to-phase voltage measurements:	
All contactor screws torqued properly: (Refer to label on contactor for correct torque value).	
Proper grounding: (Green wire must be connected to GND in the supply)	
All wiring and connectors fastened securely:	

Combustion Air

Space Air Installation	
Combustion air requirements satisfied: (Meet all applicable local and national codes).	
Combustion air free of contaminants:	
Fresh air intake requirements satisfied: (Refer to Table 15 on page 37 for minimum fresh air cross-sectional area requirements. Refer to local codes).	
Elbow installed at intake air inlet: (Required for Condair GS full size units).	

Sealed Combustion Installation	
Combustion air requirements satisfied: (Meet all applicable local and national codes).	
Intake vent type meets requirement: (ABS, PVC, CPCV or polypropylene vents permitted).	
Intake vent length: (Permissible maximum equivalent length – 100 ft (30 m); maximum 50 ft (15 m) for GS 50 using propane).	
Intake vent diameter meets requirement: (Refer to Table 16 on page 38 for vent size).	
Intake vent diameter uniform over entire length:	
Spacing between air intake and exhaust terminals meets requirement: (Minimum 3 ft (1 m) required. Refer to local codes).	
Intake vent joints and seams sealed:	
Intake vent supported with hangers or pipe straps:	
Intake vent insulated (in cold climates):	

Exhaust Venting

Exhaust venting requirements satisfied: (Meet all applicable local and national codes).	
Exhaust vent type: (Refer to Table 16 on page 38 for vent types).	
Exhaust vent length: (Permissible maximum equivalent length – 100 ft (30 m). Maximum 50 ft (15 m) for GS 50 using propane).	
Exhaust vent diameter meets requirement: (Refer to Table 17 on page 41 for exhaust vent size).	
Exhaust vent diameter uniform over entire length:	
Slope of exhaust vent meets requirement: (Minimum constant upslope of 1/2 in/12 in (2°) required).	
Exhaust vent insulated on runs over 20 ft (6.1 m):	
Exhaust vent joints and seams sealed:	
Exhaust vent supported with hangers or pipe straps:	
Condensate traps in the exhaust vent (if installed) primed with water:	

Controls

Note: If Condair control devices are installed, enter their locations below; otherwise leave fields empty.

Condair humidity controls location:	
Condair high limit switch location: (Minimum 3x absorption distance from the distributor required).	
Condair air proving switch location:	

6.1.2 Performance Checklist

Complete the performance tests after inspecting the site services and the installation, then fill out the form below.

Note: When filling out the form leave the checkbox un-checked if the item does not apply, or if the requirement is not satisfied. Enter all notes and exceptions in the space provided [on page 68](#).

Preliminary		Distribution System		
Pre-start-up checklist completed:		Note: For commissioning the distribution system itself, refer to the individual commissioning checklist for the distribution system.		
Gas leakage test inside unit completed:		SAM-e		
Check for water leaks inside unit completed:		Mini-SAM-e		
Condensate trap inside the unit primed: (Condair GS CS/NX models only).		Blower Pack		
All access panels installed and fastened securely:		ASD/BSD/CSD		
		Model:		
		Number of XSD units:		
Start-Up		Distance to obstruction: (Minimum 1× absorption distance required from the distributor to first obstruction (coil/bend) downstream).		
Shutoff valve in water supply line open:		Distance to filter: (Minimum distance between the distributor and filter downstream – 1.5-2× absorption distance for class C filter, and 2.5-3× absorption distance for sub-micron particle filter).		
Fill tests completed successfully:				
Ignition safety shutoff test completed successfully:				
Manual gas shutoff valve open:				
On/Off switch set to the On position:				
Software version:				
Controls				
Select the type of signal input connected to the channels of the low voltage terminal strip #1: (Enter setpoint value (if applicable) in the field below the checkbox).	Demand Humidistat (modulating)	On/Off Humidistat	Transducer (modulating)	Digital Controls
If a second set of inputs is connected to the channels of the low voltage terminal strip #2 (on dual cylinder units running in independent mode only), select the type of signal input connected to the terminal strip #2: (Enter setpoint value (if applicable) in the field below the checkbox).	Demand Humidistat (modulating)	On/Off Humidistat	Transducer (modulating)	Digital Controls
Control signal configuration in the software matches inputs connected to unit:				

Controls, continued...	
Sensed humidity less than setpoint value (if transducer is used):	
Security loop closed: (On a dual cylinder unit running in series or parallel mode, a jumper must be installed between the pins '2" in the two low voltage terminal strips).	
Blower pack loop closed:	
Humidifier responds to control signal interruption:	

Notes

Enter notes and exceptions in the space below.

Notes:

Commissioned by:		Commissioning Date:	
Company:			

To print the completed forms (if using an electronic version of the manual), select the **Print Form** button above. In the Print dialog box that appears, select the page numbers under Pages to Print, and the **Fit** option under Page Sizing & Handling. Click **Print**.

To save the completed electronic forms, first select the **Save Form** button above, and select "Adobe PDF" from the Printer drop-down list in the dialog box. Then select the page numbers, and click **Print**. Finally, enter a file name in the dialog box, and click **Save**.

7 Installation Checklist

The following is a consolidated installation checklist that can be used in the commissioning of the unit:

Mounting

- Unit installed in the correct location (according to ["Clearances" on page 20](#))?
- Adequate clearance for servicing unit?
- Mounting surface stable, and capable of supporting the full operating weight of the humidifier?
- Unit level?
- Unit secured properly?

Steam Line

- Observed all best practices?
- Steam pipe sized correctly?
- The steam line does not exceed maximum equivalent length listed in [Table 13 on page 27](#)?
- Long radius elbows (for rigid pipes) used?
- Backpressure in the line combined with duct static pressure does not exceed 6 in H₂O (1.49 kPa) for compact units, or 10 in H₂O (2.49 kPa) for full-size units?
- Steam line runs straight up from the humidifier steam outlet for at least 12 in (300 mm) before bend?
- Steam line has minimum upslope of 10°, or minimum downslope of 2°?
- Steam line does not reduce in diameter except at the steam distributor; and condensate line installed just before the restriction?
- Steam lines do not merge except at the steam distributor through a Condair adaptor?
- Steam line does not sag?
- Steam connections secured with clamps? Clamps torqued adequately?
- Allowances made for thermal expansion of rigid pipes, and shrinkages of steam hose?
- Steam line insulated over its entire length?

Condensate Line

- Local regulations on drain water temperature requirements have been satisfied?
- Condensate traps installed at all low points, and at horizontal-to-vertical transitions in the steam line?
- Condensate lines in the steam line always connect to full-size "Tee" connectors?
- Condensate traps have a minimum loop diameter of 12 in (300 mm) and installed at least 12 in (300 mm) below the condensate "Tee" and the steam distributor?
- All condensate lines have a minimum downslope of 1.2°?
- Condensate traps installed at regular intervals on long runs exceeding 15 ft (4.5 m)?
- Condensate lines have individual traps before emptying to a common condensate drain? Condensate drain sized appropriately to handle all the condensate?
- Condensate traps primed with water?

Water Connections

- Water quality meet the requirements listed in [Table 14 on page 34](#)?
- Shutoff valve and union fitting installed in supply line?
- Water supply piping to humidifier minimum 1/2 in (13 mm) diameter? Plastic pipe (pressure-proof and certified for use with drinking water systems), copper or stainless steel if using potable drinking water or RO water? Plastic or stainless steel pipe if using DI water?
- 5 µm water filter (optional, but recommended) installed in the supply line close to the humidifier?
- Water supply temperature 34-60 °F (1-15 °C)? Do not exceed 77 °F (25 °C).

- Double check valve backflow preventer is installed along the water supply line to the unit? Is the double check valve backflow preventer installed, adhering to all applicable local and national installation regulations?
- Water supply surge-protected and pressure regulated to 30-80 psig (207-550 kPa)?
- Check for leaks in the water supply line?
- Air gap funnel in the floor located away (max 3 ft (1 m) from the unit) from the control cabinet in the humidifier?
- Air gap funnel minimum 2-1/2 in (64 mm) in diameter?
- Drain pipe between air gap funnel and building drain have a minimum internal diameter of 1-1/2 in (38 mm)? Copper or stainless steel pipe if using potable drinking water or RO water? Stainless steel pipe if using DI water?
- Drain hose from humidifier empty into the air gap funnel without touching its sides or bottom? Drain hose have a minimum constant downslope of 1.2° and secured with hose clamp? Drain hose rated for 212 °F (100 °C)?
- Water supply line and drain lines flushed? Strainer in the fill valve free of debris?
- Condensate hose installed (CS/NX models only)? Hose rated for 212 °F (100 °C)?
- Condensate trap inside unit primed with water?

Combustion Air Connection – Space In Room Air Installation

- Fresh combustion air requirements for the room/space ([Table 15 on page 37](#) and all national and local regulations) satisfied?
- Elbow installed at the intake air inlet (on Condair GS full size units)?

Combustion Air Connection – Sealed Combustion Installation

- All relevant national and local regulations for sealed combustion installation satisfied?
- Intake vent length does not exceed an equivalent length of 100 ft (30 m)? If unit is a Condair GS 50 using propane gas, is it limited to 50 ft (15 m)? Maximum six bends?
- Vent diameter as listed in [Table 16 on page 38](#), and uniform over the entire run?
- All joints and seams sealed with appropriate sealant?
- Intake vent supported?
- Spacing between air intake terminal and exhaust vent terminal minimum 3 ft (1 m)?
- Intake vent heated and insulated in cold climates?

Exhaust Vent Connection

- Exhaust vent installed to meet all national and local codes, vent manufacturer and Condair requirements?
- Proper clearances maintained between exhaust vent and combustible materials?
- Exhaust vent diameter as listed in [Table 17 on page 41](#), and uniform over the entire run?
- Exhaust vent length does not exceed an equivalent length of 100 ft (30 m)? If unit is a Condair GS 50 using propane gas, is it limited to 50 ft (15 m)? Maximum six elbows in the exhaust vent?
- Exhaust vent diameter uniform over the entire run?
- Exhaust vent secured properly with hangers or pipe straps?

Gas Connection

- Certified manual gas shutoff valve installed immediately upstream from the humidifier?
- Thermally actuated gas shut-off device installed upstream from the humidifier? Installed the device following all local codes and regulations?
- Sediment trap installed (if using black pipe)?
- Gas pipe routing allow clear access to other service connections at humidifier?

- Gas piping adequately supported?
- Gas leakage test completed, and all leaks fixed?
- De-pressurize gas supply line after leak test?

Electrical Connections

- Power supply meet the rated current draw limits shown on the specification label ([Figure 3 on page 11](#))?
- Power supply have an external dedicated fused disconnect switch?
- All wiring done according to the wiring diagram and instructions in this manual?
- Main power cable proper grounding through the ground lug inside the electric cabinet?
- All cables fastened securely?
- All cables free of tension and pass through cable glands or grommets?
- Electrical installation meet the applicable national and local codes?
- All access panels closed and fastened securely?

8 Product Specifications

8.1 Weights

For the weights of the Condair GS humidifier models refer to ["Overall Dimensions and Weight" on page 22](#).

8.2 Dimensions

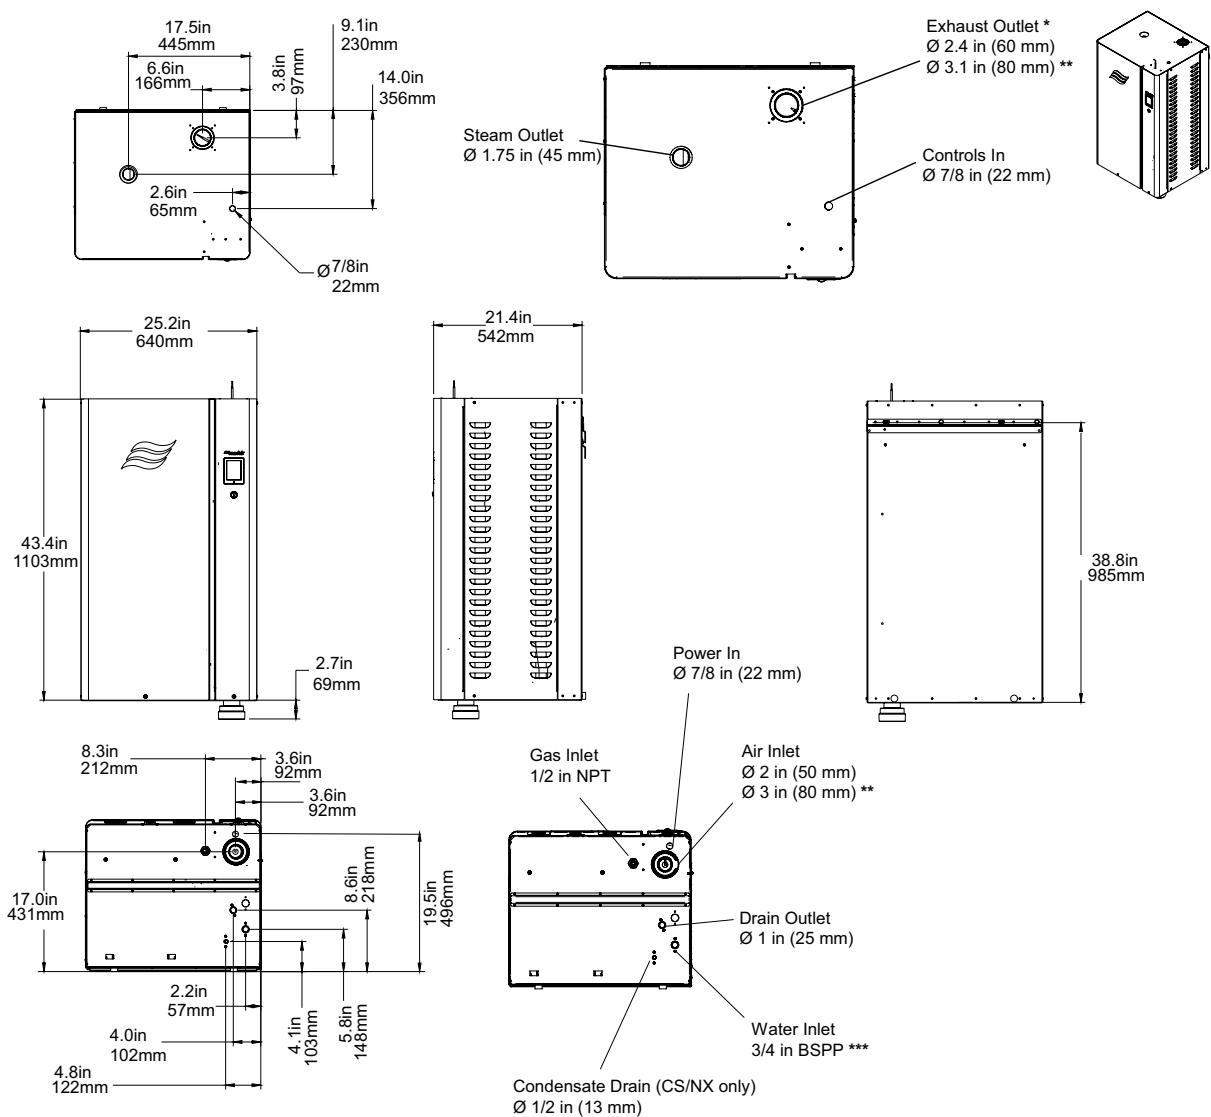


Figure 34: Condair GS 50/100

Wall mount is default. Floor stands come with the compact unit.

* Metric to imperial size adaptor supplied with unit

** Adaptor, 3 in (80 mm), for Condair GS 100

*** Water inlet 3/4 BSPP to 1/2 NPT (male) adapter supplied with the unit

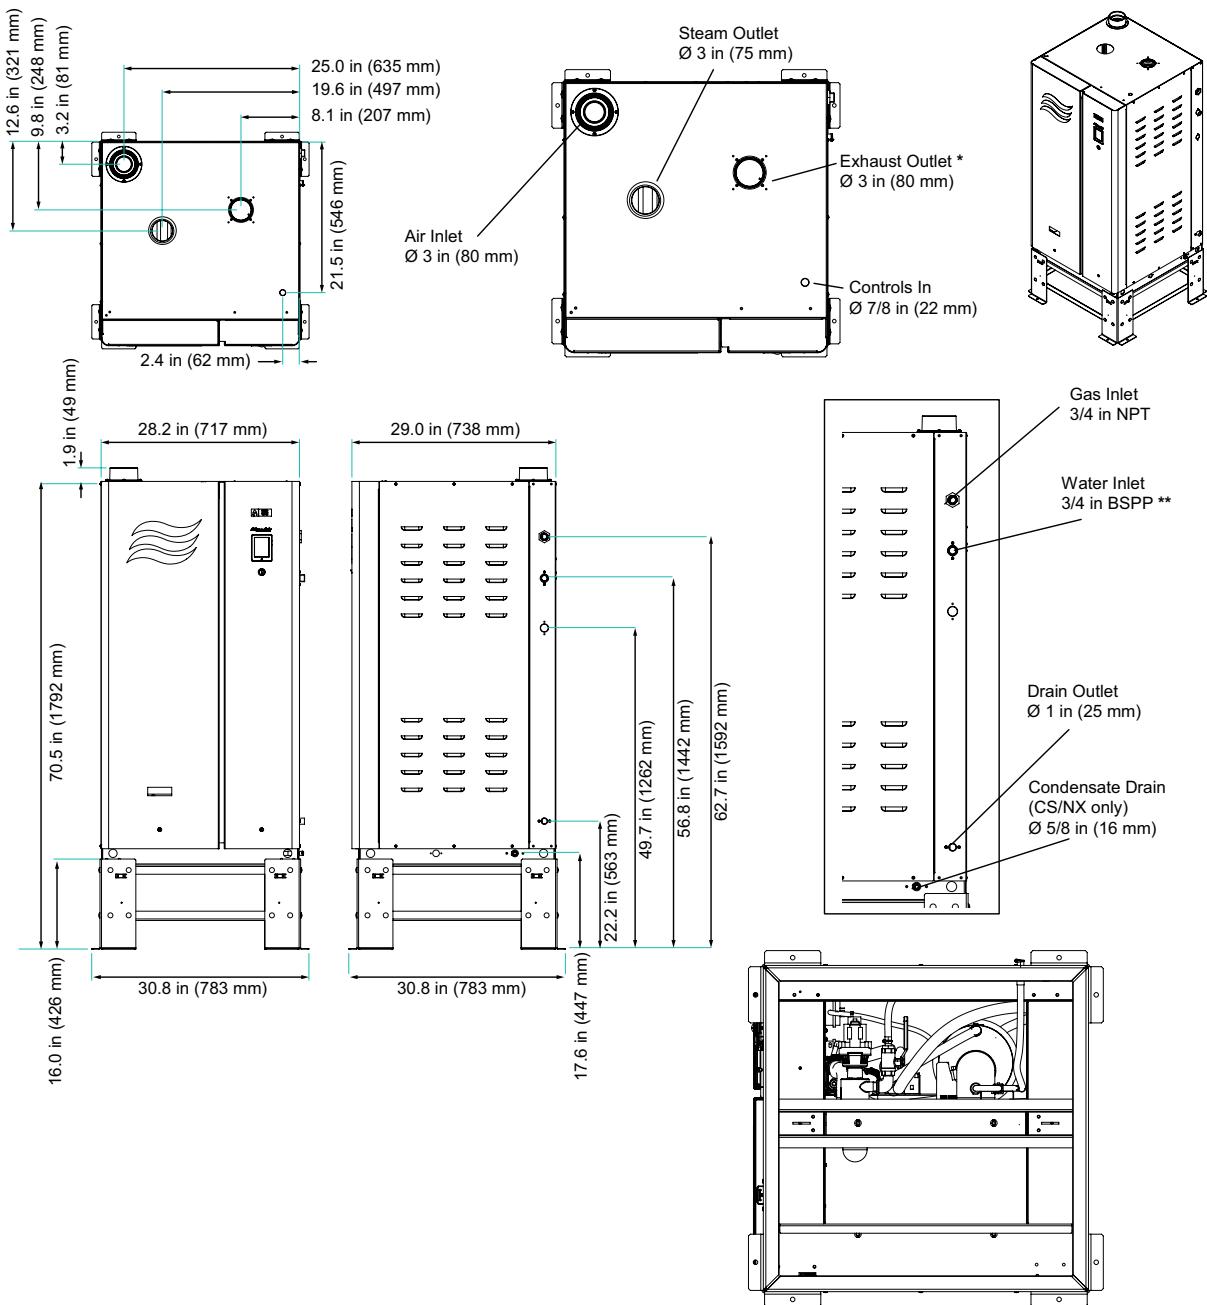


Figure 35: Condair GS 150

Mounting stand supplied with CS and NX models only. Mounting stand optional for MT model. The humidifier may also be installed directly onto the floor. Follow local guidelines.

* Metric to imperial size adaptor supplied with unit

** Water inlet 3/4 BSPP to 1/2 NPT (male) adapter supplied with the unit

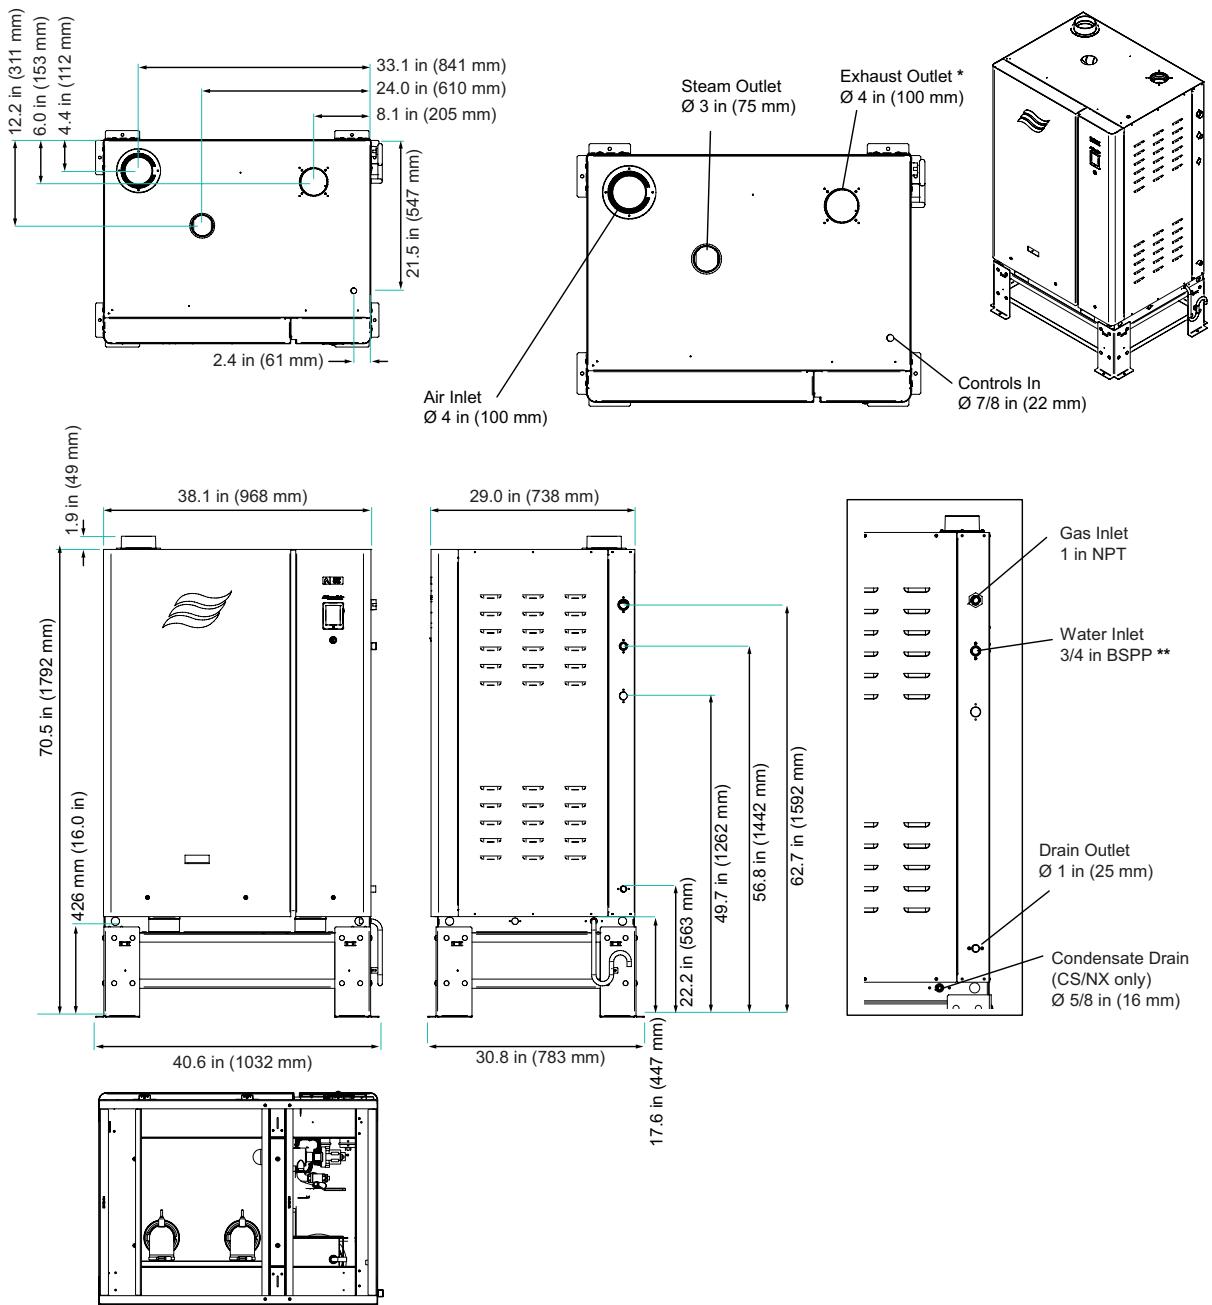


Figure 36: Condair GS 200/300

Mounting stand supplied with CS and NX models only. Mounting stand optional for MT model.

* Metric to imperial size adaptor supplied with unit

** Water inlet 3/4 BSPP to 1/2 NPT (male) adapter supplied with the unit

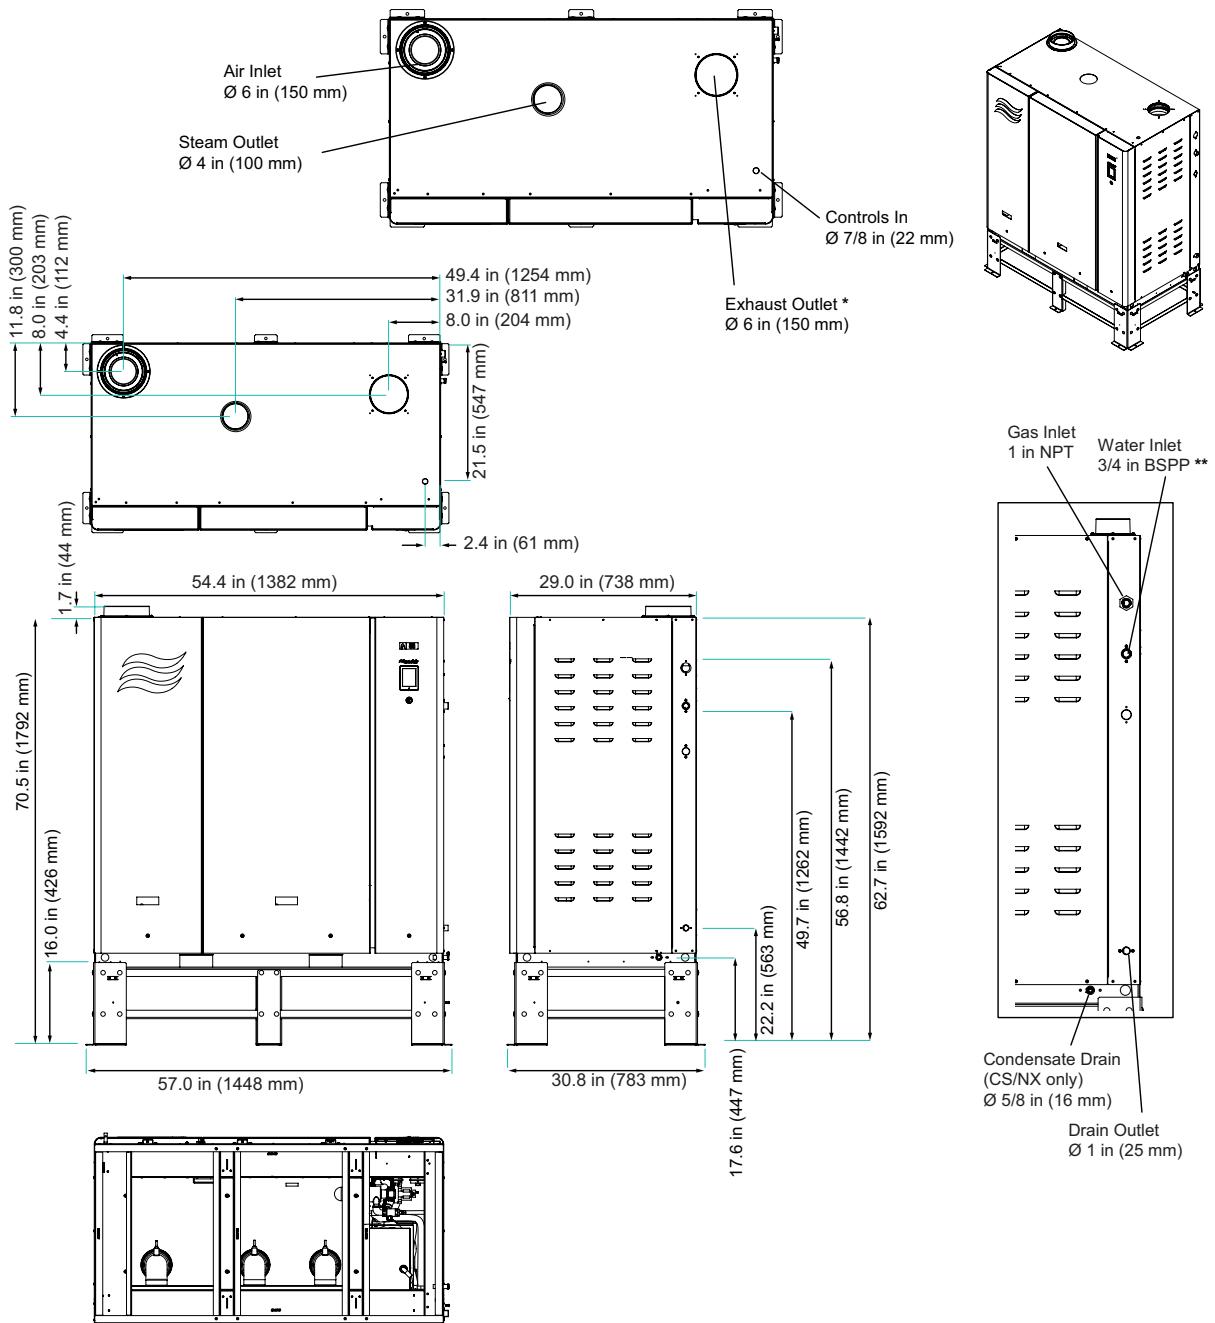


Figure 37: Condair GS 450

Mounting stand supplied with CS and NX models only. Mounting stand optional for MT model.

* Metric to imperial size adaptor supplied with unit

** Water inlet 3/4 BSPP to 1/2 NPT (male) adapter supplied with the unit

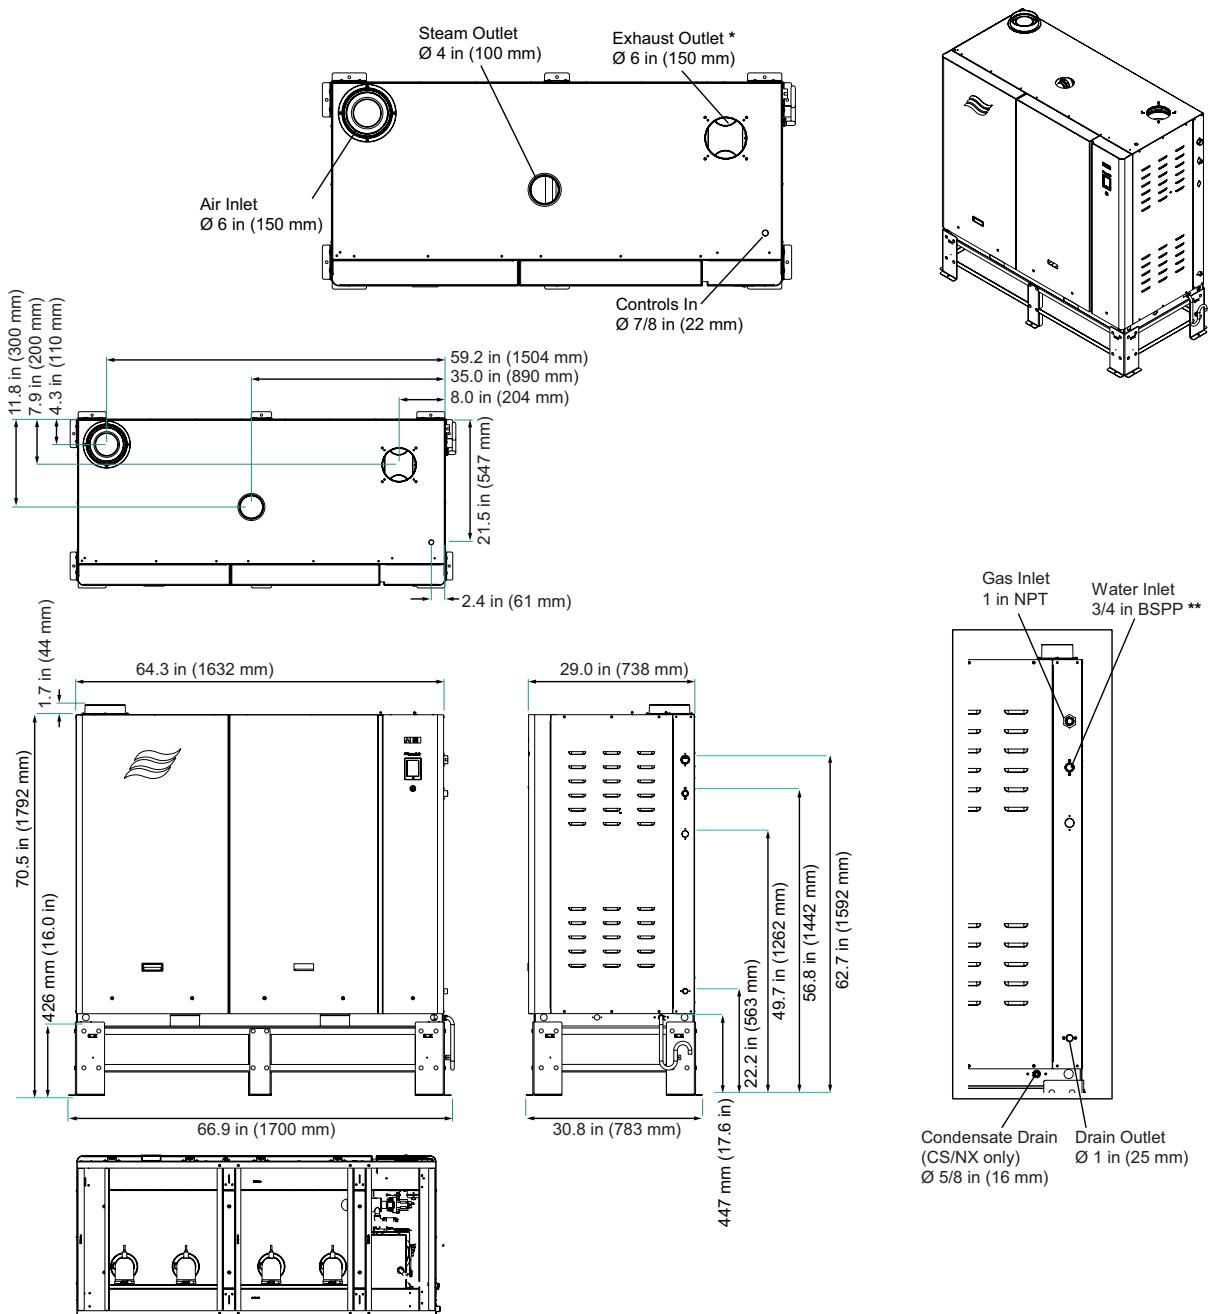


Figure 38: Condair GS 600

Mounting stand supplied with CS and NX models only. Mounting stand optional for MT model.

* Metric to imperial size adaptor supplied with unit

** Water inlet 3/4 BSPP to 1/2 NPT (male) adapter supplied with the unit

9 Performance and Operating Data

9.1 Performance Data

Condair Model	Minimum Input (gross) BTUh (kW)		Maximum Input (gross) BTUh (kW)		Min./Max. Steam Capacity lb/h (kg/h)
	Natural Gas	Propane *	Natural Gas	Propane *	
GS 50-CS	12,400 (3.6)	13,000 (3.8)	62,000 (18.2)	62,000 (18.2)	10-50 (4.5-23)
GS 50-NX	13,000 (3.8)	—	65,000 (19.0)	—	10-50 (4.6-23)
GS 50-MT	14 000 (4.1)	—	70 000 (20.5)	—	10-50 (4.6-23)
GS 100-CS	24,800 (7.3)	24,800 (7.3)	124,000 (36.3)	124,000 (36.3)	20-100 (9-45)
GS 100-NX	26,000 (7.6)	—	120,000 (35.2)	—	20-100 (9-45)
GS 100-MT	28 000 (8.2)	—	140 000 (41.0)	—	20-100 (9-45)
GS 150-CS	37,200 (10.9)	37,200 (10.9)	186,000 (54.5)	186,000 (54.5)	30-150 (13.6-68)
GS 150-NX	39,000 (11.4)	—	187,500 (55.0)	—	30-150 (13.6-68)
GS 150-MT	42 000 (12.3)	—	210 000 (61.5)	—	30-150 (13.6-68)
GS 200-CS	24,800 (7.3)	24,800 (7.3)	248,000 (72.7)	248,000 (72.7)	20-200 (9-91)
GS 200-NX	26,000 (7.6)	—	240,000 (70.3)	—	20-200 (9-91)
GS 200-MT	28 000 (8.2)	—	280 000 (82.1)	—	20-200 (9-91)
GS 300-CS	37,200 (10.9)	37,200 (10.9)	372,000 (109.0)	372,000 (109.0)	30-300 (13.6-136)
GS 300-NX	39,000 (11.4)	—	375,000 (109.9)	—	30-300 (13.6-136)
GS 300-MT	42 000 (12.3)	—	420 000 (123.1)	—	30-300 (13.6-136)
GS 450-CS	37,200 (10.9)	37,200 (10.9)	558,000 (163.5)	558,000 (163.5)	30-450 (13.6-204)
GS 450-NX	39,000 (11.4)	—	562,500 (164.9)	—	30-450 (13.6-204)
GS 450-MT	42 000 (12.3)	—	630 000 (184.6)	—	30-450 (13.6-204)
GS 600-CS	37,200 (10.9)	37,200 (10.9)	744,000 (218.0)	744,000 (218.0)	30-600 (13.6-272)
GS 600-NX	39,000 (11.4)	—	750,000 (219.8)	—	30-600 (13.6-272)
GS 600-MT	42 000 (12.3)	—	840 000 (246.2)	—	30-600 (13.6-272)

* On-site conversion kits between propane and natural gas are available.

9.2 Operating Data for GS Series II Indoor Models

Control Signal Input Types:	
Active	0-5 VDC, 1-5 VDC, 0-10 VDC, 2-10 VDC, 0-20 VDC, 0-16 VDC, 3.2-16 VDC, 0-20 mADC, 4-20 mADC
Passive	135-10 kΩ ohmic humidity sensor
On/Off control	<2.5 VDC Off, 2.5-20 VDC On
Digital (via Modbus, BACnet IP/MSTP)	BACnet IP, BACnet MSTP, Modbus, LonWorks (Option), BACnet MSTP BTL-Certified (Option), BACnet IP BTL-Certified (Option)

Ambient Conditions:	
Ambient temperature	41-104 °F (5-40 °C)
Relative humidity	5-80% (non-condensing)

Combustion Air:	
Combustion air maximum temperature	86 °F (30 °C)

Efficiency	Combustion Air CFM						
	GS 50	GS 100	GS 150	GS 200	GS 300	GS 450	GS 600
MT	15	30	46	61	91	137	182
NX	14	26	41	52	81	122	163
CS	13	27	40	54	81	121	162

Backpressure:	
Maximum permissible backpressure (duct static pressure and line backpressure)	6 in H ₂ O (1.49 kPa) for compact unit 10 in H ₂ O (2.49 kPa) for full-size unit

Gas Operating Pressure:	
Natural gas	4.5-10.0 in H ₂ O (1.1-2.4 kPa)
Propane *	9.0-13.0 in H ₂ O (2.2-3.2 kPa)

* On-site conversion kits between propane and natural gas are available.

Water Supply:	
Water pressure (regulated)	30-80 psig (3.0-8.0 bar, 300-800 kPa)
Flow rate	2.6 gpm (10 l/min) for Condair GS 50-300 , 5.3 gpm (20 l/min) for Condair GS 450-600
Water temperature	34-59 °F (1-15 °C) recommended; maximum 77 °F (25 °C)
Water quality	Cold potable water filtered to 5 µm, hardness of 0 - 20.42 gpg (0 - 350 ppm), pH level between 6.5 - 8.5 * and chloride 0-40 ppm **. * If pH is >7.5 and the content of Sodium and/or sulfates are also high, the risk of foaming is increased. ** Damage caused by chloride corrosion is not covered by your Condair warranty.

Drain Water:	
Drain water temperature	140 °F (60 °C) maximum (with drain water cooling), 212 °F (100 °C) (without drain water cooling)
Drainage capacity	5.3 gpm (20 l/min)

Power:	
Maximum current draw	15 A (slow acting fuse)

IP Rating:	
IP20 for all units	

Warranty

Condair Inc. or Condair Ltd. (depending on the entity that supplied the product, and hereinafter collectively referred to as CONDAIR) warrant for a period of two years after installation or 30 months from the manufacturer's ship date, whichever date is earlier, that CONDAIR's manufactured and assembled products, not otherwise expressly warranted, are free from defects in materials and workmanship. Notwithstanding the foregoing, the products listed below have an alternate warranty period:

- GS/GSTC Series heat exchanger(s) are warranted to be free from defects in materials and workmanship for a period of 3 years from installation or 40 months from the manufacturer's ship date, whichever is earlier.
- SAM-e Short Absorption Manifolds, except for the coupling seals, are warranted to be free from defects in materials and workmanship for a total period of 10 years from the manufacturer's ship date.
- Humilife RH humidifiers are warranted to be free from defects in materials and workmanship for a period of 5 years from the manufacturer's ship date. CONDAIR may, at its discretion, replace individual components or Humilife RH units as a whole.
- Spare Parts used for repairs are warranted for the balance of the term of the warranty on the original humidifier or 90 days, whichever is longer.
- No warranty is made against corrosion, deterioration, or suitability of substituted materials used as a result of compliance with government regulations.

CONDAIR's obligations and liabilities under this warranty are limited to furnishing replacement parts to the customer, F.O.B. CONDAIR's factory. The replacement parts are warranted for the balance of the term of the warranty on the original humidifier or 90 days, whichever is longer. Procedure:

1. Customer Requests Warranty as per instructions on the CONDAIR Warranty Form.
2. CONDAIR reviews the warranty claim and will respond in one of two ways:
 - a. Warranty Accepted – Replacement Part or credit granted.
 - b. Warranty Declined – Response with justification will be provided to the customer.
3. In some cases, CONDAIR may request the part to be returned, freight prepaid by the customer, as part of the warranty acceptance or warranty determination process. Some reasons include:
 - a. Part must be analyzed to determine the root cause of failure.
 - b. Part must be returned to the supplier for claim/investigation.

When parts are requested to be returned, replacement parts will be sent by CONDAIR to the customer against an invoice from CONDAIR paid by the customer. The cost of the replacement parts will be reimbursed to the customer with a credit note after the parts are received and analyzed by CONDAIR, if the warranty is accepted.

The warranties set forth herein are in lieu of all other warranties expressed or implied by law. No liability whatsoever shall be attached to CONDAIR until said products have been paid for in full and then said liability shall be limited to the original purchase price for the product. Any further warranty, with the exception of a purchased extended warranty described below, must be in writing, and signed by an officer of CONDAIR.

CONDAIR makes no warranty and assumes no liability unless the equipment is installed in strict accordance with the installation manual in effect at the date of purchase, and by properly qualified and licensed professionals capable of installing such equipment.

CONDAIR makes no warranty and assumes no liability whatsoever for consequential damage or damage resulting directly from misapplication, incorrect sizing, or lack of proper maintenance of the equipment.

CONDAIR makes no warranty and assumes no liability whatsoever for damage to the products, humidifier, supply lines, drain lines, steam distribution systems, or the building as a whole caused by freezing.

CONDAIR reserves the right to change the design, specifications, and performance criteria of its products without notice or obligation.

Extended Warranty

Extended warranties are available to purchase under the conditions listed above. Extended warranties must be purchased at the time of the original equipment order.



ISO 9001
QMI-SAI Global



A.G.A. 12-94
Gas Fired Humidifier



CGA CR98-004
Gas Fired Humidifier



www.condairparts.com

Buy authentic Condair
parts factory direct.



Would you recommend Condair?
Take our two question survey.

U.S.A.
1021 6th Street
Racine, WI 53403

CANADA
2740 Fenton Road
Ottawa, Ontario K1T 3T7

TEL: 1.866.667.8321
EMAIL: na.info@condair.com
WEBSITE: www.condair.com



 **condair**